



Intermountain GeoEnvironmental Services, Inc.  
12429 S. 300 E. Ste. 100, Draper, Utah 84020  
~ T: (801) 748-4044 ~ F: (801) 748-4045

August 14, 2018

National Ability Center  
1000 Ability Way  
Park City, Utah 84060  
Attn: Jon Serio

IGES Project No. 02763-001

RE: **NAC - Recreation Center Observation Letter**  
**National Ability Center**  
**1000 Ability Way**  
**Park City, Utah 84060**

Reference Report: IGES, 2018, Geotechnical Investigation – National Ability Center,  
1000

Ability Way, Park City, UT 84060, Project No. 02763-001, dated  
March 29, 2018

Mr. Serio:

As requested, IGES performed an additional soil investigation for the proposed Recreation Center to be constructed at the National Ability Center (1000 Ability Way) in Park City, Utah (See Figure A-1). The new investigation was located just east of the original investigation (IGES, March 2018). The original investigation made in March consisted of three test pits (TP-1 to TP-3). This new investigation consisted of one additional test pit (TP-4) directly located where the proposed Recreation Center is to be constructed. The client once again provided a mini excavator to perform the excavations. During this investigation, we were looking for soil conditions in the area of the Recreation Center that were different than were found in the original report that might adversely change the recommendations made within that report.

## **FIELD INVESTIGATION**

At the time of our site visit on July 13, 2018, one additional test pit (TP-4) was excavated just outside the footprint of the proposed Recreation Center structure. The approximate location of the exploration is shown on Figure A-2 (*Geotechnical Map*) in Appendix A. The test pit was excavated to approximately 10 feet in depth below the existing site grade. Soil samples were obtained at various layers within the excavation in order to allow for additional lab testing to be performed.

The soils exposed in Test Pit 4 consisted of up to 1-foot of arena footing overlay that was overlaying the native top soil. The topsoil consisted of approximately 1-foot of Clayey SAND (SC) that was medium dense and moist. Below the arena footing and topsoil was a native layer of Sandy Fat CLAY (CH) with Gravel that was stiff to very stiff and moist. This layer extended down to approximately 5 feet below the existing arena grade. Below

the sandy fat clay, the soils contained more sands and were classified as a Clayey SAND (SC) that was dense and moist. Some cobbles and boulders up to 24 inches in diameter were also observed intermittently. This layer extended to approximately 8.5 feet below the existing arena grade when a Clayey GRAVEL (GC) with Sand was then encountered and extended the remaining depth of the test pit. This clayey gravel layer was very dense and moist. The soils were classified according to the *Unified Soil Classification System* (USCS) by the Geotechnical Engineer. An excavation log of the subsurface conditions, as encountered in the exploration, was recorded at the time of the exploration by a member of our technical staff and is presented as Figure A-3 in Appendix A.

Soil sampling was completed to collect representative samples of the various layers observed at the site. Disturbed samples were collected at 4, 6.5, and 9.5 feet below grade and were collected in plastic bags. All samples were transported to our laboratory to evaluate the engineering properties of the various earth materials observed.

No groundwater was encountered during our investigation. It is not anticipated that groundwater will impact any construction of the proposed developments, however, the groundwater table can raise and lower with seasonal weather. If groundwater is encountered during construction, IGES should be informed to verify that the recommendations presented in the original report (IGES, March 2018) are still valid with the new conditions.

## **LABORATORY TESTING**

Geotechnical laboratory tests were conducted on the soil samples obtained during our field investigation. The laboratory testing program was designed to evaluate the engineering characteristics of the onsite earth materials. The testing performed on the samples were selected to provide a better comparison of the soils encountered during the original test pits (TP-1 to TP-3). Laboratory tests conducted during this investigation included:

- Moisture Content (ASTM D2216)
- Particle Size Distribution (Gradation) - Sieve Analysis (ASTM D6913)
- Percent Finer than No. 200 - Sieve Wash (ASTM D1140)

Select results of laboratory tests completed for this investigation are presented on the Test Pit Log on Figure A-3 in Appendix A. The complete laboratory results are presented in Appendix B.

## **CONCLUSIONS**

Based on our investigation, the soils encountered are similar to the soils encountered in the original investigation. It is our opinion that the design and construction recommendations contained in the original report (IGES, March 2018) are still relevant and can be applied to the construction of the proposed Recreation Center.

The following sections present the relevant recommendations for the proposed Recreation Center, based on this investigation and the original investigation performed previously.

## SEISMICITY

Following the criteria outlined in the 2015 International Building Code (IBC, 2015), spectral response at the site was evaluated for the *Maximum Considered Earthquake* (MCE) which equates to a probabilistic seismic event having a two percent probability of exceedance in 50 years (2PE50). Spectral accelerations were determined based on the location of the site using the *U.S. Seismic “Design Maps” Web Application* (USGS, 2012); this software incorporates seismic hazard maps depicting probabilistic ground motions and spectral response data developed for the United States by the U. S. Geological Survey as part of NEHRP/NSHMP (Frankel et al., 1996). These maps have been incorporated into both *NEHRP Recommended Provisions for Seismic Regulations for New Buildings and Other Structures* (FEMA, 1997) and the *International Building Code* (IBC) (International Code Council, 2015).

To account for site effects, site coefficients that vary with the magnitude of spectral acceleration and *Site Class* are used. Site Class is a parameter that accounts for site amplification effects of soft soils and is based on the average shear wave velocity of the upper 100 feet; based on our field exploration and our understanding of the geology in this area, the subject site is appropriately classified as Site Class D (*stiff soil*). Based on IBC criteria, the short-period ( $F_a$ ) and long-period ( $F_v$ ) site coefficients are 1.301 and 1.983, respectively. Based on the design spectral response accelerations for a *Building Risk Category* of I, II, or III, the site’s *Seismic Design Category* is D. The short- and long-period *Design Spectral Response Accelerations* are presented in Table 5-1; a summary of the *Design Maps* analysis is presented in Appendix C. The *peak ground acceleration* (PGA) may be taken as  $0.4 \cdot S_{MS}$ .

**Short- and Long-Period Spectral Accelerations for MCE**

<b>Parameter</b>	<b>Short Period (0.2 sec)</b>	<b>Long Period (1.0 sec)</b>
Mapped Spectral Acceleration (g)	$S_S = 0.624$	$S_1 = 0.209$
MCE Spectral Response Acceleration Modified for Site Class D (g)	$S_{MS} = 0.812$	$S_{M1} = 0.414$
Design Spectral Response Acceleration (5 percent Damping) (g)	$S_{DS} = 0.541$	$S_{D1} = 0.276$

## EARTHWORK

Prior to the placement of foundations, general site grading is recommended to provide proper support for foundations, exterior concrete flatwork, concrete slabs-on-grade, and pavement sections. Site grading is also recommended to provide proper drainage and moisture control on the subject property and to aid in preventing differential movement in foundation soils as a result of variations in subgrade conditions.

## **General Site Preparation and Grading**

Below proposed structures, fills, and man-made improvements, all vegetation, topsoil, debris and undocumented fill (e.g. arena footing overlay) should be removed. Any existing utilities should be re-routed or protected in-place. Tree roots may be encountered and should be grubbed-out and replaced with engineered fill, if exposed in the foundation excavation. The foundation excavation should be assessed for soft or loose soils; any soft/loose areas should be compacted in place if the depth is less than 6 inches or removed and replaced with structural fill. Footings may be placed on suitable native clayey soils that have not been allowed to dry out after the excavation is completed. The soils exposed in the subgrade should be moisture conditioned to near the in-situ moisture content.

## **Excavations**

Excavations should extend through any undocumented fill or topsoil and into the native soils. If fat clay soils are exposed, they should not be allowed to dry out and crack but should be kept moist and/or covered until backfilled. If these soils dry out, they will need to be over excavated and removed.

If over-excavation is required, the excavations should extend a minimum of 1 foot laterally for every foot of depth of over-excavation. Excavations should extend laterally at least two feet beyond slabs-on-grade. Structural fill may be placed to bring the excavation back to desired grade. The native Fat CLAY (CH) soils should not be used as structural fill.

An IGES representative should observe the site preparation and grading operations to assess whether the recommendations presented have been complied with. Soft or loose soils observed in the excavation should be removed prior to placing structural fill or constructing footings.

## **Trench Excavations**

Based on our soil observations, visual classifications and laboratory testing, it is our opinion that the native soils at the site classify as Occupational Safety and Health Administration (OSHA) Type B soils. According to OSHA standards, trenches with vertical walls up to 4 feet in depth may be occupied. IGES observed that the soil layers in the upper 4 to 5 feet tended to be moist, stiff to very stiff, and easily maintained a nearly vertical cut. Below 4 to 5 feet the soil layers became more granular and could slough into the bottom of the excavation creating a potentially dangerous undercut in the excavation sidewall. When a trench is deeper than 5 feet, we recommend that the sides of the excavation be sloped back at a 1H:1V slope or that a trench-shield or shoring be used as a protective system for workers in the trench.

The contractor is responsible for trench and site safety. Pertinent OSHA requirements should be met to provide a safe work environment. If site specific conditions arise that require engineering analysis in accordance with OSHA regulations, IGES can respond and provide recommendations as needed. We recommend that an IGES representative observe all excavations to assess exposed foundation soils.

## **Expansive Soils, Structural Fill and Compaction**

Based on field observations and testing results, the expansion potential of on-site, undisturbed native Fat CLAY (CH), is low if they are not allowed to dry out and crack but instead kept moist and/or covered until backfilled. The expansion potential was highest when these fat clay soils were allowed to dry and were remolded (i.e. used as structural fill). Swelling soils can potentially damage foundation elements, crack concrete slabs, and create excess stress in the proposed structures. Although soils classifying as fat clay are often associated with expansive soils, soil classification alone cannot predict the expansive characteristics of clay soils.

Collapse/Swell potential of soils tests (ASTM D4546) were completed on two of the representative clay samples collected as part of the original investigation to further assess the expansive characteristics of site soils. One test (TP-3) was completed on a relatively undisturbed sample at the existing (in-situ) moisture content. The other test (TP-2) was completed on a disturbed sample that was compacted (remolded) to a dry density that was approximately 7 percent greater than the in-situ dry density and allowed to air dry before beginning the test. The purpose of testing the remolded sample was to assess the suitability of this soil to be used as backfill or structural fill. The results of the collapse/swell potential performed with the original investigation is presented in the following table.

**Collapse/Swell Potential of Soils Test Results Summary**

Test Pit	Depth (ft.)	Swell (%)	Load (psf)	Notes
TP-2	2.5	26.3	100	Remolded
TP-3	2.0	0.6	800	Undisturbed

Based on these results, native Fat CLAY (CH) soils are moisture sensitive with a high potential to expand if used as structural fill and can be very difficult to achieve the desired compaction and moisture content. We recommend that native fine-grained soils such as Fat CLAY (CH) not be used as structural fill in any aspects of this project.

All fill placed for the support of structures, flatwork or pavements, should consist of structural fill that is an approved imported granular material. Imported soil used as structural fill should be a relatively well-graded granular soil with a maximum of 50 percent passing the No. 4 sieve and a maximum fines content (minus No. 200 mesh sieve) of 20 percent. Structural fill should be relatively free of vegetation and debris and contain no materials larger than 4 inches in nominal size (6 inches in greatest dimension). All structural fill soils should be approved by the geotechnical engineer prior to placement.

All structural fill should be placed in maximum 6-inch loose lifts if compacted by small hand-operated compaction equipment, maximum 8-inch loose lifts if compacted by light-to medium-duty rollers, and maximum 10-inch loose lifts if compacted by heavy-duty compaction equipment that is capable of efficiently compacting the entire thickness of the lift. We recommend that all structural fill be compacted on a horizontal plane.

The moisture content for all structural fill should be near (typically within +/- 2%) the optimum moisture content (OMC) at the time of placement and compaction of any structural fill. Ideally, the moisture content should be slightly above the OMC to minimize the amount of compaction energy required to achieve proper compaction. Also, prior to placing any fill, the excavation should be observed by the geotechnical engineer to evaluate whether all undocumented fill, topsoil, and loose soils have been removed. In addition, proper grading should precede placement of fill, as described in the *General Site Preparation and Grading* section. The following Table lists the compaction requirements for different structural fill placements.

<b>Compaction Requirements</b>	
<b>Structural Fill Location</b>	<b>Percent MMD Required (ASTM D-1557 Modified Proctor)</b>
Structural Elements (e.g. Below Structures, Footings, Pavement Sections, Concrete Flatwork, Curb and Gutter, and Sidewalks)	95%
Non-Structural Elements (e.g. Landscape Areas, Foundation Wall Backfill)	90%

Failure to properly moisture-condition and compact backfill may result in settlements of up to several inches within the fill if the moisture content of the backfill increases. Only small compaction equipment, such as jumping jacks and walk-behind/remote controlled compacters, should be used near in-place structural elements (e.g. above footings, near foundation walls, etc.).

The gradation, placement, moisture and compaction recommendations contained in this section meet our minimum requirements. If other governing agencies such as utility, city, county or state entities have more stringent requirements which exceed our recommendations, the more stringent specifications are to be followed.

### **Soft Soil Stabilization**

If soft and/or pumping soils are encountered, stabilization of these soils should be accomplished by using a clean, coarse angular material worked into the soft subgrade. We recommend the coarse angular material be greater than 3 inches in nominal diameter, but less than 6 inches. The stabilization material should be worked (pushed) into the soft subgrade soils until a relatively firm and unyielding surface is established. Once a relatively firm and unyielding surface is achieved, the area may be brought to final design grade using structural fill. Other earth materials not meeting aforementioned criteria may also be suitable; however, such material should be evaluated on a case-by-case basis and should be approved by IGES prior to use.

The placement of a woven geotextile and compacted structural fill may be used as an alternative or in conjunction to the procedures previously described to stabilize soft soils. The woven geotextile should consist of either Mirafi HP 370 or an approved equivalent.

The geotextile should be placed to cover the entire excavation bottom where structural fill will be placed. The geotextile should be installed in accordance with the manufacturer's recommendations; seams should be overlapped a minimum of 12 inches. Following placement of the geotextile, compacted structural fill may be placed to the required grade.

## FOUNDATIONS

It is anticipated that the proposed foundation elements of the Recreation Center will consist of conventional spread footings and strip footings. Strip footings should be a minimum of 24 inches wide, isolated spread footings should be a minimum of 36 inches wide. Exterior footings should be embedded at least 42 inches below final grade for frost protection and confinement. Interior footings not exposed to the full effects of frost should be embedded at least 12 inches for confinement. Settlements of properly designed and constructed conventional footings, founded as described above, are anticipated to be less than 1 inch. Differential settlements should be on the order of half the total settlement over 30 feet.

Considering the soil conditions encountered at the site, we recommend that footings be founded either *entirely* on undisturbed, moisture conditioned, native soils or *entirely* on a minimum of 24 inches of structural fill extending to undisturbed native soils. Based off laboratory testing and the soils observed at the site, IGES recommends that foundations should be designed for a minimum net allowable bearing capacity of 800 psf and a maximum of **1,800 psf**, to minimize settlement.

If soft, loose, or otherwise deleterious earth materials are exposed on the foundation subgrade we recommend the material be removed and replaced with structural fill. Fill/native transition zones are not allowed. Where utilized, all fill beneath the foundations should consist of structural fill and should be placed and compacted in accordance with our recommendations presented in the *Structural Fill and Compaction* section above.

IGES should observe all foundation subgrade prior to placement of steel or concrete to assess that the soils are suitable and, if applicable, have not dried out and cracked.

## CONCRETE SLAB-ON-GRADE CONSTRUCTION

Concrete slabs-on-grade should be constructed over suitable dense native soils or a zone of structural fill with a minimum thickness of 12 inches that extends to relatively undisturbed native soils. Below all slabs we recommend 4 inches of clean, compacted, free-draining gravel. Any structural fill placed should meet the requirements in the *Structural Fill and Compaction* section. If soft soils are exposed following the over-excavation, they should be removed or stabilized by the methods discussed in the *Soft Soil Stabilization* section.

All concrete slabs should be designed to minimize cracking as a result of shrinkage. This should include appropriate spacing of concrete control joints and saw-cut joints. The maximum joint spacing should be 24 to 36 times the thickness of the slab (in feet) but limited to a maximum of 15 feet. The joints should be square or nearly square (not to exceed 1.5 times the width) (ACI 224.3R). Additionally, consideration should be given to reinforcing the slab with welded wire, re-bar, or fiber mesh, as appropriate. All concrete

work should be performed in accordance with the American Concrete Institute (ACI) codes and recommendations.

## **EARTH PRESSURE AND LATERAL RESISTANCE**

Lateral forces imposed upon conventional foundations due to wind or seismic forces may be resisted by the development of passive earth pressures and friction between the base of the footing and the supporting soils.

Based on an internal angle of friction of 32° and a unit weight of 118 pcf, the ultimate lateral earth pressures for granular backfill soils acting against retaining walls and buried structures may be computed from the lateral pressure coefficients or equivalent fluid densities presented in the following table:

<b>Condition</b>	<b>Lateral Pressure Coefficient</b>	<b>Equivalent Fluid Density (pounds per cubic foot)</b>
Active*	0.31	36
At-rest**	0.47	55
Passive*	3.25	384
Seismic (Active)***	0.48	57
Seismic (Passive)***	2.78	328

\* Based on Coulomb's equation

\*\* Based on Jaky

\*\*\* Based on Mononobe-Okabe

These coefficients and densities assume level, granular backfill with no buildup of hydrostatic pressures. If sloping backfill, surcharges or groundwater are present, we recommend the geotechnical engineer be consulted to provide more accurate lateral pressure parameters once the design geometry is established.

Clayey soils drain poorly and may swell upon wetting, thereby greatly increasing lateral pressures acting on earth retaining structures. Therefore, clayey soils should not be used as retaining wall backfill. Backfill should consist of either native granular soil or sandy imported material.

Walls and structures allowed to rotate slightly should use the active condition. If the element is constrained against rotation (e.g., basement wall), the at-rest condition should be used. These values should be used with an appropriate factor of safety against overturning and sliding. A value of 1.5 is typically used.

## **MOISTURE PROTECTION AND SURFACE DRAINAGE**

Precautions should be taken during and after construction to minimize the potential for saturation of foundation soils. Over wetting the soils prior to or during construction will likely result in increased softening, pumping or swelling of the soils, causing equipment mobility problems and difficulty in achieving compaction. Moisture should not be allowed to infiltrate the soils in the vicinity of, or upslope from, the construction location.

Conversely, where fat clays are exposed under proposed pavements, slabs-on-grade, or similar structural elements, the clays should not be allowed to dry out. Where exposed, these soils should be occasionally moistened, or kept covered with plastic sheeting or a few inches of soil to minimize drying-out until just before construction. We have included the following as minimum recommendations:

- Backfill around foundations should consist of native soils placed in maximum 12-inch loose lifts, moisture conditioned and compacted to approximately 90 percent of the maximum dry density as established by the Modified Proctor (ASTM D1557) in landscaped areas and a minimum of 95 percent beneath concrete slabs or other structural elements. Compacting by means of injecting water or “jetting” is not recommended.
- Rain gutters should be installed around the entire perimeter of the structure to collect and discharge all roof runoff a minimum of 10-feet from foundation elements or as far away as is practically possible. If 10-feet cannot be achieved then a pipe, swale or some other conveyance feature should be installed to carry the water immediately away from the foundation.
- The ground surface within 10-feet of the foundations should be sloped to drain away from the structure with a minimum fall of 6 inches (5%). If this cannot be achieved, then the ground surface should be sloped to the property line or as far as practical and a conveyance feature used to carry the water to the front or rear of the property.
- All pressurized irrigation lines and valves should be placed outside the limits of the foundation backfill. Only hand watering or drip irrigation should be used within this zone and preferably desert landscaping or xeriscape should be used to eliminate the need for irrigation in this zone.

## **LIMITATIONS**

The concept of risk is a significant consideration of geotechnical analysis. The analytical means and methods used in performing geotechnical analyses and development of resulting recommendations do not constitute an exact science. Analytical tools used by geotechnical engineers are based on limited data, empirical correlations, engineering judgement and experience. As such, the solutions and resulting recommendations presented in this report cannot be considered risk-free and constitute IGES’s best professional opinions and recommendations based on the available data and other design information available at the time they were developed. IGES has developed the preceding analyses, recommendations and designs at a minimum, in accordance with generally accepted professional geotechnical engineering practices and care being exercised in the project area at the time our services were performed. No warranties, guarantees or other representations are made.

The information contained in this investigation is based on limited field testing and understanding of the project. It is very likely that variations in the soil, rock and groundwater conditions exist between and beyond the points explored. The nature and extent of variations may not be evident until construction occurs and additional explorations are completed. If any conditions are encountered that differ from those described in this report, IGES must be immediately notified so that we may make any

necessary revisions to recommendations contained in this report. In addition, if the scope of the proposed construction changes from that described in this report, our firm must also be notified.

This report was prepared for our client's exclusive use on the project identified in the foregoing. Use of the data, recommendations or design information contained herein for any other project or development of the site not as specifically described in this report is at the user's sole risk and without the approval of IGES, Inc. It is the client's responsibility to see that all parties to the project, including the designer, contractor, subcontractors, etc. are made aware of this report in its entirety. The use of information contained in this report for bidding purposes should be done at the contractor's option and risk.

We recommend that IGES be retained to review the final design plans, grading plans and specifications to determine if our engineering recommendations have been properly incorporated in the project development documents. We also suggest that IGES be retained to evaluate construction performance and other geotechnical aspects of the projects as construction initiates and progresses through its completion.

### **ADDITIONAL SERVICES**

The recommendations made in this report are based on the assumption that an adequate program of tests and observations will be made during the construction. IGES staff should be on site to verify compliance with these recommendations. These tests and observations should include, but not necessarily be limited to, the following:

- Observations and testing during site preparation, earthwork and structural fill placement.
- Observation of footing excavations.
- Consultation as may be required during construction.
- Quality control on concrete placement to verify slump, air content, and strength.

We also recommend that project plans and specifications be reviewed by us to verify compatibility with our conclusions and recommendations. Additional information concerning the scope and cost of these services can be obtained from our office.


Respectfully submitted,  
**IGES, Inc.**



Logan M. Palmer, E.I.T.  
Staff Engineer



Kent A. Hartley, P.E.  
Principal Engineer

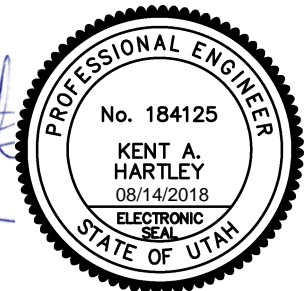

**Attachments:** Appendix A - Figure A-1 – Site Vicinity Map  
Figure A-2 – Geotechnical Map  
Figure A-3 – Site Photos  
Figure A-4 – Test Pit 1 Excavation Log (March 2018 Investigation)  
Figure A-5 – Test Pit 2 Excavation Log (March 2018 Investigation)  
Figure A-6 – Test Pit 3 Excavation Log (March 2018 Investigation)  
Figure A-7 – Test Pit 4 Excavation Log (This Investigation)  
Figure A-8 – Key to Soil Symbols and Terminology

Appendix B - Laboratory Testing Summary (This Investigation)

Appendix C - Laboratory Testing Summary (March 2018 Investigation)

Appendix D - USGS Design Maps Summary Report  
USGS Design Maps Detailed Report

**Additional References Cited:**

Federal Emergency Management Agency [FEMA], 1997, NEHRP Recommended Provisions for Seismic Regulations for New Buildings and Other Structures, FEMA 302, Washington, D.C.

International Building Code [IBC], 2015, International Code Council, Inc.

*Joints in Concrete Construction*, ACI 224.3R-95, American Concrete Institute, Farmington Hills, MI


United States Geological Survey, Park City East Quadrangle Map 7.5 Minute Series.

USGS, 2012/2015, U.S. Seismic “Design Maps” Web Application (<https://geohazards.usgs.gov/secure/designmaps/us/application.php>), uses the International Building Code (2012 IBC)

# **APPENDIX A**




BASE MAP: PARK CITY EAST QUADRANGLE UTAH-UTAH CO - U.S.G.S. 7.5 MINUTE QUADRANGLE, 2017



PROJECT NUMBER: 02763-001


#### SITE VICINITY MAP

GEOTECHNICAL INVESTIGATION  
NAC - RECREATION CENTER  
1000 ABILITY WAY  
PARK CITY, UT 84060



FIGURE

A-1

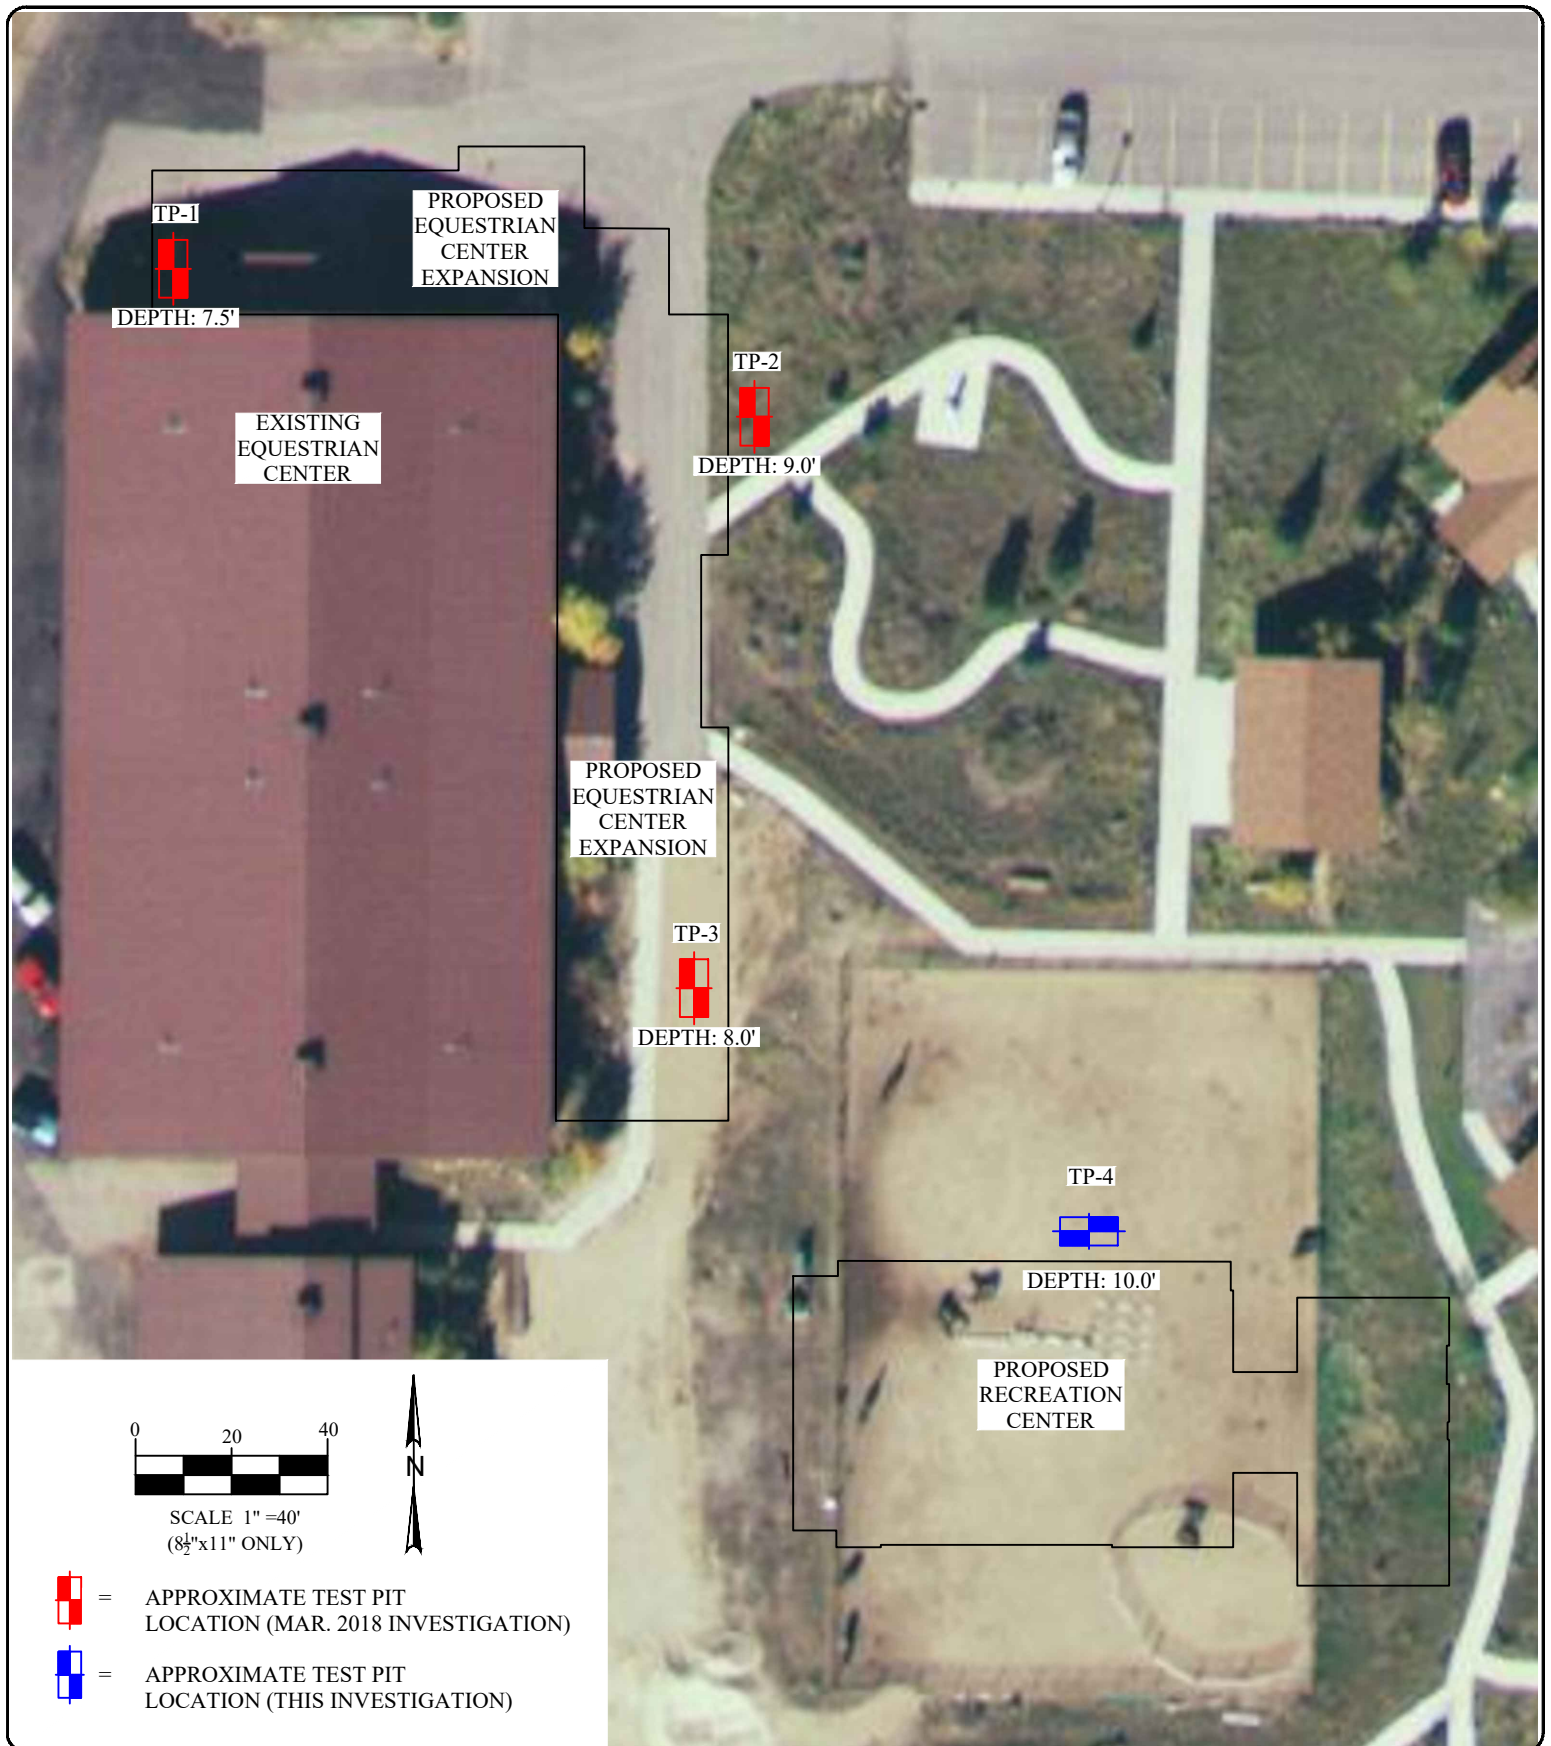

AERIAL IMAGES FROM UTAH GIS HRO IMAGERY IMAGES 12TVL560000, 12TVL560040, 12TVL600000, AND 12TVL600040, DATE OF IMAGES SPRING, 2012. PROPERTY LINES BASED FROM MAPS.SUMMITCOUNTY.ORG/FLEXVIEWERS/COUNTYMAP.



TEST PIT 4




TEST PIT 4



TEST PIT 4



TEST PIT 4

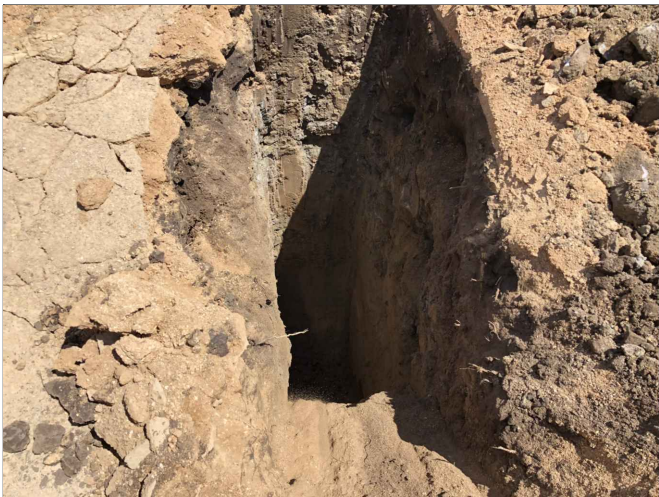

TEST PIT 4



TEST PIT 4

PHOTOS TAKEN ON JULY 12, 2018

DATE		STARTED: 3/9/18		<b>Geotechnical Investigation</b> <b>National Ability Center</b> <b>1000 Ability Way</b> <b>Park City, UT 84060</b>				IGES Rep: LMP		TEST PIT NO: <b>TP - 1</b> Sheet 1 of 1	
		COMPLETED: 3/9/18						Rig Type: Mini Excavator			
		BACKFILLED: 3/9/18						Project Number 02763-001			
DEPTH		ELEVATION		LOCATION		Dry Density(pcf)		Moisture Content %		Moisture Content and Atterberg Limits	
FEET		SAMPLES		LATITUDE 40.68125 LONGITUDE -111.47600 ELEVATION 6735						Plastic Limit Moisture Content Liquid Limit	
WATER LEVEL		GRAPHICAL LOG		MATERIAL DESCRIPTION							
		UNIFIED SOIL CLASSIFICATION								10 20 30 40 50 60 70 80 90	
0		SC		Top Soil - Clayey SAND - medium dense, moist, dark brown Roots down to 2.5 feet below grade							
1											
2		CH		Sandy Fat CLAY w/ gravel- stiff, moist, brown		18.7		53 34			
3											
4						103.7		18.9			
5											
6		GC		Clayey GRAVEL w/ Sand - very dense, moist, brown Cobbles up to 4 inches in diameter							
7											
8				No Groundwater Encountered		14.4		13.7			
9											



Copyright (c) 2018, IGES, INC.

## SAMPLE TYPE

- GRAB SAMPLE  
 - 3" O.D. THIN-WALLED HAND SAMPLER

## WATER LEVEL

- MEASURED  
 - ESTIMATED

## NOTES:

Figure

A-4

DATE		STARTED: 3/9/18		COMPLETED: 3/9/18		BACKFILLED: 3/9/18		Geotechnical Investigation National Ability Center 1000 Ability Way Park City, UT 84060 Project Number 02763-001				IGES Rep: LMP Rig Type: Mini Excavator		TEST PIT NO: <b>TP - 2</b> Sheet 1 of 1	
DEPTH		ELEVATION		SAMPLES		WATER LEVEL		GRAPHICAL LOG		UNIFIED SOIL CLASSIFICATION		LOCATION LATITUDE 40.68118 LONGITUDE -111.47556 ELEVATION -6732			
												Moisture Content and Atterberg Limits			
												Plastic Limit Moisture Content Liquid Limit			
												10 20 30 40 50 60 70 80 90			
0										SC		Top Soil - Clayey SAND - dense, moist, dark brown Roots/rootlets down to 2.5 feet below grade			
1										CH		Fat CLAY - stiff to very stiff, moist, dark brown			
2															
3										CH		Sandy Fat CLAY - very stiff, moist, light brown w/ white. Highly calcareous deposits from 2.5 feet to 5.0 feet			
4												Pocket Penetrometer: 5.0+ tsf			
5												18.1 62 44			
6															
7															
8												22.5 58.0			
9												No Groundwater Encountered			



Copyright (c) 2018, IGES, INC.

## SAMPLE TYPE

- GRAB SAMPLE  
 - 3" O.D. THIN-WALLED HAND SAMPLER

## WATER LEVEL

- MEASURED  
 - ESTIMATED

## NOTES:

**Figure**  
**A-5**

DATE		STARTED: 3/9/18		<b>Geotechnical Investigation</b> <b>National Ability Center</b> <b>1000 Ability Way</b> <b>Park City, UT 84060</b>				IGES Rep: LMP		TEST PIT NO: <b>TP - 3</b> Sheet 1 of 1									
		COMPLETED: 3/9/18						Rig Type: Mini Excavator											
		BACKFILLED: 3/9/18						Project Number 02763-001											
DEPTH		ELEVATION		LOCATION		Dry Density(pcf)		Moisture Content %		Percent minus 200		Liquid Limit		Plasticity Index		Moisture Content and Atterberg Limits			
FEET		SAMPLES		WATER LEVEL		GRAPHICAL LOG		UNIFIED SOIL CLASSIFICATION		MATERIAL DESCRIPTION								Plastic Limit   Moisture Content   Liquid Limit 	
0								GP		Undocumented Fill - Poorly-graded GRAVEL w/ Sand - dense, wet (Frozen), light brown Frozen from winter weather conditions								10 20 30 40 50 60 70 80 90	
1								CH		Topsoil; Fat CLAY - very stiff, moist, black Pocket Penetrometer: 5.0+ tsf									
2										Fat CLAY - Stiff, moist, light brown Pocket Penetrometer: 3.5 tsf		97.2		21.4					
3																			
4								SP-SC		SAND with Clay and Gravel - very dense, moist, light brown Cobbles & Boulders throughout layer Pocket Penetrometer: 5.0+ tsf									
5																			
6																			
7																			
8												14.0		7.8					
9										No Groundwater Encountered									



Copyright (c) 2018, IGES, INC.

## SAMPLE TYPE

- GRAB SAMPLE  
 - 3" O.D. THIN-WALLED HAND SAMPLER

## WATER LEVEL

- MEASURED  
 - ESTIMATED

## NOTES:

Figure

A-6

DATE	STARTED: 7/12/18	National Ability Center - Recreation Center 1000 Ability Way Park City, UT 84060 Project Number 02763-001	IGES Rep: LMP		TEST PIT NO: TP - 4								
	COMPLETED: 7/12/18		Rig Type: Mini Excavator		Sheet 1 of 1								
	BACKFILLED: 7/12/18												
DEPTH	ELEVATION	FEET	SAMPLES	WATER LEVEL	GRAPHICAL LOG	UNIFIED SOIL CLASSIFICATION	LOCATION LATITUDE 40.68068 LONGITUDE -111.47533 ELEVATION 6728	Dry Density(pcf)	Moisture Content %	Percent minus 200	Liquid Limit	Plasticity Index	Moisture Content and Atterberg Limits
							MATERIAL DESCRIPTION						Plastic Limit Moisture Content Liquid Limit 10 20 30 40 50 60 70 80 90
		0					Non-Native - Arena Footing Overlay						
		1					Native - Top Soil - Clayey SAND - medium dense, moist, dark brown Roots down to 2 feet below grade						
		2				CH	Native - Sandy Fat CLAY w/ Gravel - stiff to very stiff, moist, dark grey/brown						
		3											
		4											
		5				SC	Native - Clayey SAND w/ Gravel - dense, moist, light brown Cobbles and Boulders up to 24 inches in diameter						
		6											
		7					Gravel: 3.9%, Sand: 52.4%, Fines: 43.7% Intermittent layers (3-5 inches) of Fat CLAY (CH) - very stiff, moist, light brown	24.1					
		8											
		9				GC	Native - Clayey GRAVEL w/ Sand - very dense, moist, brown						
		10					No Groundwater Encountered	14.1					



Copyright (c) 2018, IGES, INC.

## SAMPLE TYPE

- GRAB SAMPLE  
 - 3" O.D. THIN-WALLED HAND SAMPLER

## WATER LEVEL

- MEASURED  
 - ESTIMATED

## NOTES:

Figure

A-7

# UNIFIED SOIL CLASSIFICATION SYSTEM

MAJOR DIVISIONS			USCS SYMBOL	TYPICAL DESCRIPTIONS
COARSE GRAINED SOILS  (More than half of material is larger than the #200 sieve)	GRAVELS  (More than half coarse fraction is larger than the #4 sieve)	CLEAN GRAVELS WITH LITTLE OR NO FINES	GW	WELL-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE OR NO FINES
			GP	POORLY-GRADED GRAVELS, GRAVEL-SAND MIXTURES WITH LITTLE OR NO FINES
		GRAVELS WITH OVER 12% FINES	GM	SILTY GRAVELS, GRAVEL-SILT-SAND MIXTURES
			GC	CLAYEY GRAVELS, GRAVEL-SAND-CLAY MIXTURES
	SANDS  (More than half coarse fraction is smaller than the #4 sieve)	CLEAN SANDS WITH LITTLE OR NO FINES	SW	WELL-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE OR NO FINES
			SP	POORLY-GRADED SANDS, SAND-GRAVEL MIXTURES WITH LITTLE OR NO FINES
		SANDS WITH OVER 12% FINES	SM	SILTY SANDS, SAND-GRAVEL-SILT MIXTURES
			SC	CLAYEY SANDS SAND-GRAVEL-CLAY MIXTURES
FINE GRAINED SOILS  (More than half of material is smaller than the #200 sieve)	SILTS AND CLAYS  (Liquid limit less than 50)	ML	INORGANIC SILTS & VERY FINE SANDS, SILTY OR CLAYEY FINE SANDS, CLAYEY SILTS WITH SLIGHT PLASTICITY	
		CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS	
		OL	ORGANIC SILTS & ORGANIC SILTY CLAYS OF LOW PLASTICITY	
	SILTS AND CLAYS  (Liquid limit greater than 50)	MH	INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILT	
		CH	INORGANIC CLAYS OF HIGH PLASTICITY, FAT CLAYS	
		OH	ORGANIC CLAYS & ORGANIC SILTS OF MEDIUM-TO-HIGH PLASTICITY	
		HIGHLY ORGANIC SOILS		PT

## MOISTURE CONTENT

DESCRIPTION	FIELD TEST
DRY	ABSENCE OF MOISTURE, DUSTY, DRY TO THE TOUCH
MOIST	DAMP BUT NO VISIBLE WATER
WET	VISIBLE FREE WATER, USUALLY SOIL BELOW WATER TABLE

## STRATIFICATION

DESCRIPTION	THICKNESS	DESCRIPTION	THICKNESS
SEAM	1/16-1/2"	OCCASIONAL	ONE OR LESS PER FOOT OF THICKNESS
LAYER	1/2-12"	FREQUENT	MORE THAN ONE PER FOOT OF THICKNESS

## APPARENT / RELATIVE DENSITY - COARSE-GRAINED SOIL

APPARENT DENSITY	SPT (blows/ft)	MODIFIED CA. SAMPLER (blows/ft)	CALIFORNIA SAMPLER (blows/ft)	RELATIVE DENSITY (%)	FIELD TEST
VERY LOOSE	<4	<4	<5	0 - 15	EASILY PENETRATED WITH 1/2-INCH REINFORCING ROD PUSHED BY HAND
LOOSE	4 - 10	5 - 12	5 - 15	15 - 35	DIFFICULT TO PENETRATE WITH 1/2-INCH REINFORCING ROD PUSHED BY HAND
MEDIUM DENSE	10 - 30	12 - 35	15 - 40	35 - 65	EASILY PENETRATED A FOOT WITH 1/2-INCH REINFORCING ROD DRIVEN WITH 5-LB HAMMER
DENSE	30 - 50	35 - 60	40 - 70	65 - 85	DIFFICULT TO PENETRATE 12" WITH 1/2-INCH REINFORCING ROD DRIVEN WITH 5-LB HAMMER
VERY DENSE	>50	>60	>70	85 - 100	PENETRATED ONLY FEW INCHES WITH 1/2-INCH REINFORCING ROD DRIVEN WITH 5-LB HAMMER

CONSISTENCY - FINE-GRAINED SOIL		TORVANE	POCKET PENETROMETER	FIELD TEST
CONSISTENCY	SPT (blows/ft)	UNTRAINED SHEAR STRENGTH (tsf)	UNCONFINED COMPRESSIVE STRENGTH (tsf)	
VERY SOFT	<2	<0.125	<0.25	EASILY PENETRATED SEVERAL INCHES BY THUMB. EXUDES BETWEEN THUMB AND FINGERS WHEN SQUEEZED BY HAND.
SOFT	2 - 4	0.125 - 0.25	0.25 - 0.5	EASILY PENETRATED ONE INCH BY THUMB. MOLDED BY LIGHT FINGER PRESSURE.
MEDIUM STIFF	4 - 8	0.25 - 0.5	0.5 - 1.0	PENETRATED OVER 1/2 INCH BY THUMB WITH MODERATE EFFORT. MOLDED BY STRONG FINGER PRESSURE.
STIFF	8 - 15	0.5 - 1.0	1.0 - 2.0	INDENTED ABOUT 1/2 INCH BY THUMB BUT PENETRATED ONLY WITH GREAT EFFORT.
VERY STIFF	15 - 30	1.0 - 2.0	2.0 - 4.0	READILY INDENTED BY THUMBNAIL.
HARD	>30	>2.0	>4.0	INDENTED WITH DIFFICULTY BY THUMBNAIL.

## LOG KEY SYMBOLS

	BORING SAMPLE LOCATION		TEST-PIT SAMPLE LOCATION
	WATER LEVEL (level after completion)		WATER LEVEL (level where first encountered)

## CEMENTATION

DESCRIPTION	DESCRIPTION
WEAKLY	CRUMBLES OR BREAKS WITH HANDLING OR SLIGHT FINGER PRESSURE
MODERATELY	CRUMBLES OR BREAKS WITH CONSIDERABLE FINGER PRESSURE
STRONGLY	WILL NOT CRUMBLE OR BREAK WITH FINGER PRESSURE

## OTHER TESTS KEY

C	CONSOLIDATION	SA	SIEVE ANALYSIS
AL	ATTERBERG LIMITS	DS	DIRECT SHEAR
UC	UNCONFINED COMPRESSION	T	TRIAXIAL
S	SOLUBILITY	R	RESISTIVITY
O	ORGANIC CONTENT	RV	R-VALUE
CBR	CALIFORNIA BEARING RATIO	SU	SOLUBLE SULFATES
COMP	MOISTURE/DENSITY RELATIONSHIP	PM	PERMEABILITY
CI	CALIFORNIA IMPACT	-200	% FINER THAN #200
COL	COLLAPSE POTENTIAL	Gs	SPECIFIC GRAVITY
SS	SHRINK SWELL	SL	SWELL LOAD

## MODIFIERS

DESCRIPTION	%
TRACE	<5
SOME	5 - 12
WITH	>12

## GENERAL NOTES

- Lines separating strata on the logs represent approximate boundaries only. Actual transitions may be gradual.
- No warranty is provided as to the continuity of soil conditions between individual sample locations.
- Logs represent general soil conditions observed at the point of exploration on the date indicated.
- In general, Unified Soil Classification designations presented on the logs were evaluated by visual methods only. Therefore, actual designations (based on laboratory tests) may vary.



## KEY TO SOIL SYMBOLS AND TERMINOLOGY

FIGURE

A-8

# **APPENDIX B**

## **Laboratory Testing Summary (This Investigation)**

# Water Content and Unit Weight of Soil

(In General Accordance with ASTM D7263 Method B and D2216)

**Project:** NAC - Recreation Center

**No:** 02763-001 (II)

**Location:** Park City, Utah

**Date:** 7/19/2018

**By:** BSS

Sample Info.	Boring No.	TP-1	TP-1					
	Sample							
	Depth	6.5'	9.5'					
	Split	Yes	No					
	Split sieve	3/8"						
Total sample (g)		3301.79						
Moist coarse fraction (g)		66.09						
Moist split fraction (g)		3235.70						
	Sample height, H (in)							
	Sample diameter, D (in)							
	Mass rings + wet soil (g)							
	Mass rings/tare (g)							
	Moist unit wt., $\gamma_m$ (pcf)							
Coarse Fraction	Wet soil + tare (g)	193.76						
	Dry soil + tare (g)	190.47						
	Tare (g)	127.67						
	Water content (%)	5.2						
Split Fraction	Wet soil + tare (g)	437.06	4131.64					
	Dry soil + tare (g)	378.43	3711.72					
	Tare (g)	139.73	735.12					
	Water content (%)	24.6	14.1					
Water Content, w (%)		24.1	14.1					
Dry Unit Wt., $\gamma_d$ (pcf)								

Entered by: \_\_\_\_\_

Reviewed: \_\_\_\_\_

# Particle-Size Distribution (Gradation) of Soils Using Sieve Analysis

(ASTM D6913)

**IGES**  
© IGES 2004, 2018

**Project: NAC - Recreation Center**

**No: 02763-001 (II)**

**Location: Park City, Utah**

**Date: 7/20/2018**

**By: BSS**


**Boring No.: TP-1**

**Sample:**

**Depth: 6.5'**

**Description: Brown clayey sand**

Split: Yes Split sieve: 3/8" Moist Total sample wt. (g): 3031.79 +3/8" Coarse fraction (g): 66.09 -3/8" Split fraction (g): 297.33  Split fraction: 0.974 Dry 2443.70 62.80 238.70				<u>Water content data</u> C.F.(+3/8") S.F.(-3/8") Moist soil + tare (g): 193.76 437.06 Dry soil + tare (g): 190.47 378.43 Tare (g): 127.67 139.73 Water content (%): 5.2 24.6	
Sieve	Accum. Wt. Ret. (g)	Grain Size (mm)	Percent Finer	← Split	
8"	-	200	-		
6"	-	150	-		
4"	-	100	-		
3"	-	75	-		
1.5"	-	37.5	-		
3/4"	-	19	100.0		
3/8"	62.80	9.5	97.4		
No.4	3.28	4.75	96.1		
No.10	11.22	2	92.9		
No.20	23.92	0.85	87.7		
No.40	42.80	0.425	80.0		
No.60	64.45	0.25	71.1		
No.100	93.21	0.15	59.4		
No.140	110.45	0.106	52.3		
No.200	131.59	0.075	43.7		

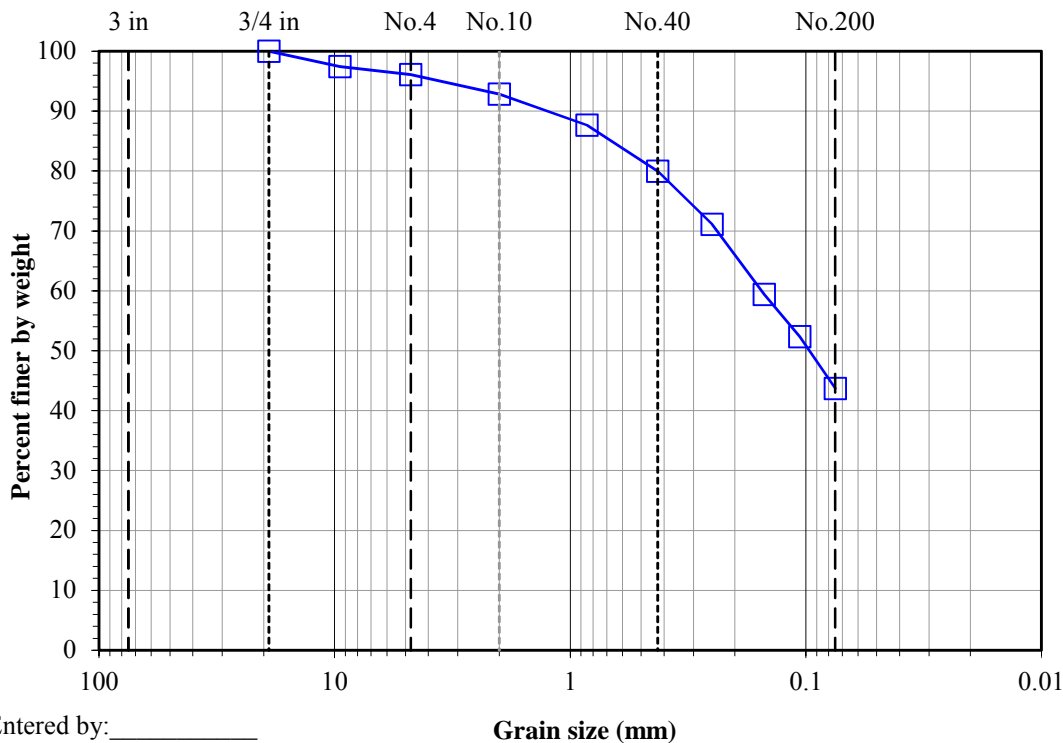

**Gravel (%): 3.9**  
**Sand (%): 52.4**  
**Fines (%): 43.7**

Entered by: \_\_\_\_\_  
Reviewed: \_\_\_\_\_

**Amount of Material in Soil Finer than the No. 200 (75µm) Sieve**

(ASTM D1140)

**Project: NAC - Recreation Center****No: 02763-001 (II)****Location: Park City, Utah****Date: 7/20/2018****By: BSS**

Sample Info.	Boring No.	TP-1						
	Sample							
	Depth	4.0'						
	Split	Yes						
	Split Sieve*	3/8"						
	Method	B						
Specimen soak time (min)		240						
Moist total sample wt. (g)		3954.38						
Moist coarse fraction (g)		812.48						
Moist split fraction + tare (g)		400.19						
Split fraction tare (g)		120.09						
Dry split fraction (g)		234.36						
Dry retained No. 200 + tare (g)		258.93						
Wash tare (g)		120.09						
No. 200 Dry wt. retained (g)		138.84						
Split sieve* Dry wt. retained (g)		767.09						
Dry total sample wt. (g)		3395.92						
Coarse Fraction	Moist soil + tare (g)	1276.40						
	Dry soil + tare (g)	1231.02						
	Tare (g)	464.08						
	Water content (%)	5.92						
Split Fraction	Moist soil + tare (g)	400.19						
	Dry soil + tare (g)	354.45						
	Tare (g)	120.09						
	Water content (%)	19.52						
Percent passing split sieve* (%)		77.4						
Percent passing No. 200 sieve (%)		31.6						

Entered by: \_\_\_\_\_

Reviewed: \_\_\_\_\_

# **APPENDIX C**

## **Laboratory Testing Summary (March 2018 Investigation)**

# Water Content and Unit Weight of Soil

(In General Accordance with ASTM D7263 Method B and D2216)

**Project:** National Ability Center

**No:** 02763-001

**Location:** Park City, Utah

**Date:** 3/16/2018

**By:** EH

Sample Info.	Boring No.	TP-2	TP-3						
	Sample:								
	Depth:	4.0'	2.0'						
Unit Weight Info.	Sample height, H (in)		2.996						
	Sample diameter, D (in)		2.419						
	Sample volume, V (ft <sup>3</sup> )		0.0080						
	Mass rings + wet soil (g)		555.64						
	Mass rings/tare (g)		129.22						
	Moist soil, Ws (g)		426.42						
	Moist unit wt., $\gamma_m$ (pcf)		117.98						
Water Content	Wet soil + tare (g)	482.10	457.39						
	Dry soil + tare (g)	427.86	398.26						
	Tare (g)	127.45	122.30						
Water Content, w (%)		18.1	21.4						
Dry Unit Wt., $\gamma_d$ (pcf)			97.2						

Entered by: \_\_\_\_\_

Reviewed: \_\_\_\_\_

**Liquid Limit, Plastic Limit, and Plasticity Index of Soils**

(ASTM D4318)



© IGES 2004, 2018



**Project: National Ability Center****No: 02763-001**Location: **Park City, Utah**Date: **3/20/2018**By: **BRR**Grooving tool type: **Plastic**Liquid limit device: **Mechanical**Rolling method: **Hand****Boring No.: TP-1****Sample:****Depth: 2.0'**Description: **Brown fat clay**Preparation method: **Air Dry**Liquid limit test method: **Multipoint**Screened over No.40: **Yes**Larger particles removed: **Dry sieved**Approximate maximum grain size: **3/4"**Estimated percent retained on No.40: **Not requested**As-received water content (%): **Not requested****Plastic Limit**

Determination No	1	2				
Wet Soil + Tare (g)	12.77	13.56				
Dry Soil + Tare (g)	11.77	12.54				
Water Loss (g)	1.00	1.02				
Tare (g)	6.45	7.05				
Dry Soil (g)	5.32	5.49				
Water Content, w (%)	18.80	18.58				

**Liquid Limit**

Determination No	1	2	3			
Number of Drops, N	33	23	18			
Wet Soil + Tare (g)	14.81	14.05	14.90			
Dry Soil + Tare (g)	12.28	11.74	12.23			
Water Loss (g)	2.53	2.31	2.67			
Tare (g)	7.30	7.37	7.38			
Dry Soil (g)	4.98	4.37	4.85			
Water Content, w (%)	50.80	52.86	55.05			
One-Point LL (%)		52				

<b>Liquid Limit, LL (%)</b>	<b>53</b>
<b>Plastic Limit, PL (%)</b>	<b>19</b>
<b>Plasticity Index, PI (%)</b>	<b>34</b>

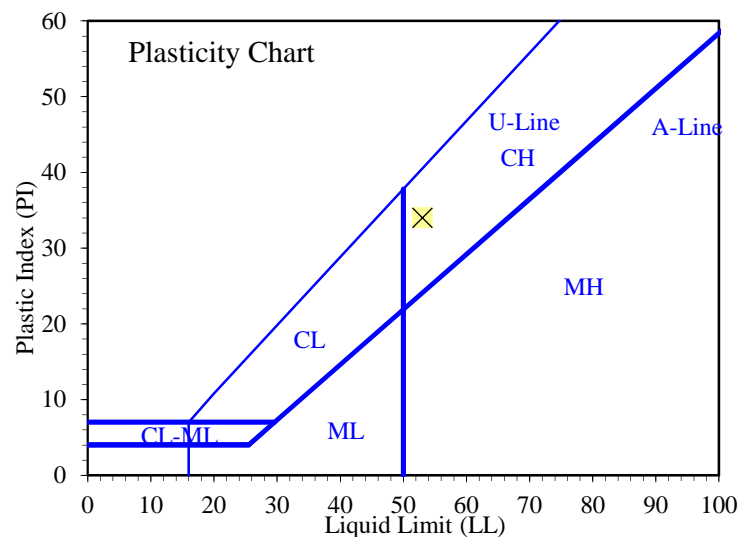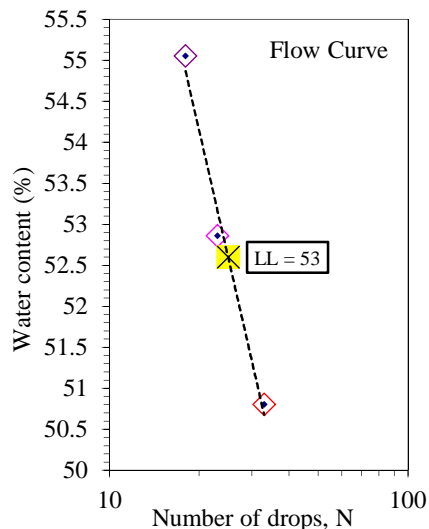

Entered by: \_\_\_\_\_

Reviewed: \_\_\_\_\_

Z:\PROJECTS\02763\_National\_Ability\_Center\001\_Addition\ALv2.xlsm]1

**Liquid Limit, Plastic Limit, and Plasticity Index of Soils**

(ASTM D4318)



© IGES 2004, 2018



**Project:** National Ability Center**No:** 02763-001**Location:** Park City, Utah**Date:** 3/20/2018**By:** BRR**Grooving tool type:** Plastic**Liquid limit device:** Mechanical**Rolling method:** Hand**Boring No.:** TP-2**Sample:****Depth:** 4.0'**Description:** Brown fat clay**Preparation method:** Air Dry**Liquid limit test method:** Multipoint**Screened over No.40:** Yes**Larger particles removed:** Dry sieved**Approximate maximum grain size:** Not requested**Estimated percent retained on No.40:** Not requested**Plastic Limit****As-received water content (%):** 18.1

Determination No	1	2				
Wet Soil + Tare (g)	13.13	13.47				
Dry Soil + Tare (g)	12.21	12.48				
Water Loss (g)	0.92	0.99				
Tare (g)	7.07	7.04				
Dry Soil (g)	5.14	5.44				
Water Content, w (%)	17.90	18.20				

**Liquid Limit**

Determination No	1	2	3			
Number of Drops, N	30	23	17			
Wet Soil + Tare (g)	15.02	14.58	15.32			
Dry Soil + Tare (g)	12.02	11.67	12.11			
Water Loss (g)	3.00	2.91	3.21			
Tare (g)	7.02	7.05	7.11			
Dry Soil (g)	5.00	4.62	5.00			
Water Content, w (%)	60.00	62.99	64.20			
One-Point LL (%)	61	62				

<b>Liquid Limit, LL (%)</b>	<b>62</b>
<b>Plastic Limit, PL (%)</b>	<b>18</b>
<b>Plasticity Index, PI (%)</b>	<b>44</b>

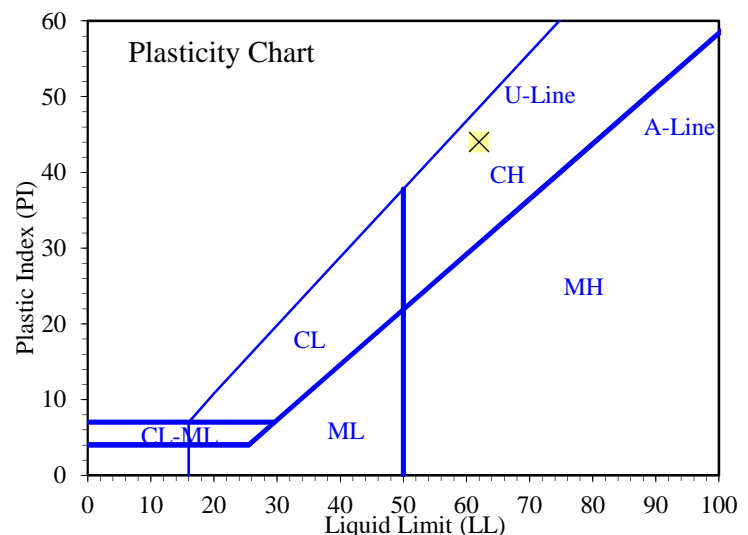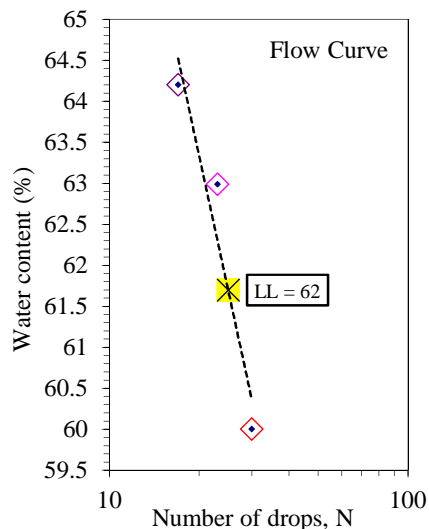

Entered by: \_\_\_\_\_

Reviewed: \_\_\_\_\_

# Particle-Size Distribution (Gradation) of Soils Using Sieve Analysis

(ASTM D6913)

**Project:** National Ability Center

**No:** 02763-001

**Location:** Park City, Utah

**Date:** 3/19/2018

**By:** JWB


**Boring No.:** TP-1

**Sample:**

**Depth:** 7.0'

**Description:** Brown silty, clayey gravel with sand

Split: Yes Split sieve: 3/8" Moist Total sample wt. (g): 2598.90 +3/8" Coarse fraction (g): 890.51 -3/8" Split fraction (g): 363.89  Split fraction: 0.634 Dry 2272.31 831.85 306.82				<u>Water content data</u> C.F.(+3/8") S.F.(-3/8") Moist soil + tare (g): 1214.53 569.87 Dry soil + tare (g): 1154.26 512.80 Tare (g): 299.54 205.98 Water content (%): 7.1 18.6	
Sieve	Accum. Wt. Ret. (g)	Grain Size (mm)	Percent Finer	←Split	
8"	-	200	-		
6"	-	150	-		
4"	-	100	-		
3"	-	75	100.0		
1.5"	314.76	37.5	86.1		
3/4"	608.33	19	73.2		
3/8"	831.85	9.5	63.4		
No.4	35.23	4.75	56.1		
No.10	88.97	2	45.0		
No.20	135.38	0.85	35.4		
No.40	171.47	0.425	28.0		
No.60	200.48	0.25	22.0		
No.100	221.35	0.15	17.7		
No.140	232.19	0.106	15.4		
No.200	240.30	0.075	13.7		

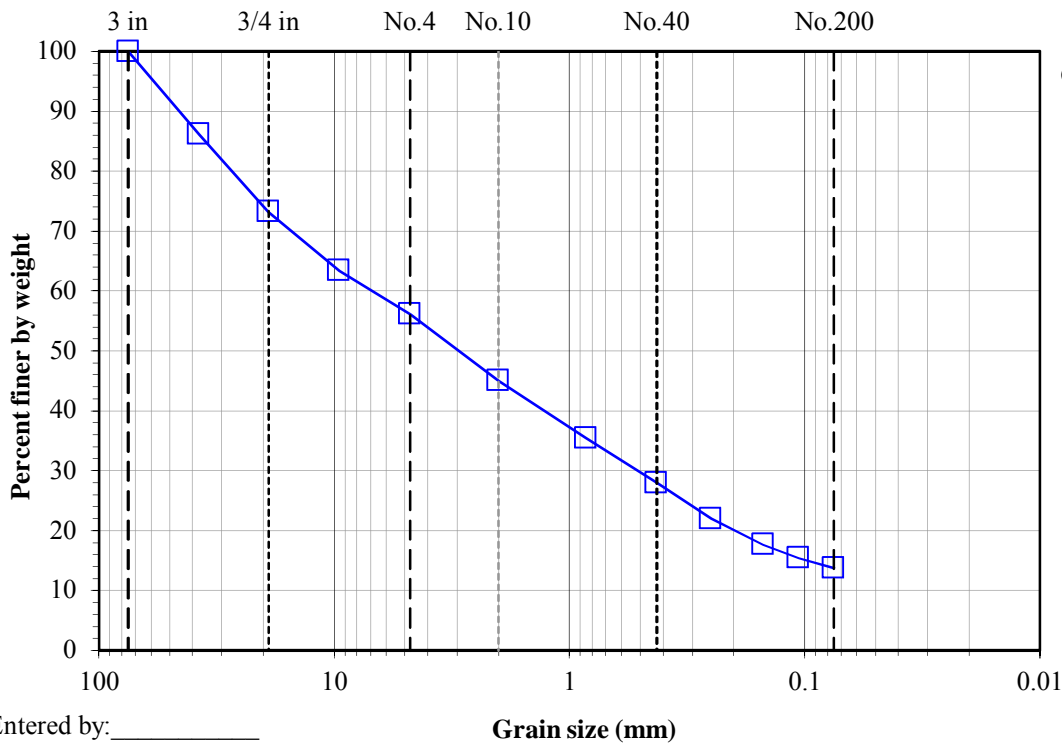

**Gravel (%):** 43.9  
**Sand (%):** 42.4  
**Fines (%):** 13.7

Entered by: \_\_\_\_\_  
Reviewed: \_\_\_\_\_

# Particle-Size Distribution (Gradation) of Soils Using Sieve Analysis

(ASTM D6913)

**IGES**  
© IGES 2004, 2018

**Project:** National Ability Center

**No:** 02763-001

**Location:** Park City, Utah

**Date:** 3/19/2018

**By:** JWB


**Boring No.:** TP-3

**Sample:**

**Depth:** 7.5'

**Description:** Brown sand with silty clay and gravel

<div>Split: Yes</div> <div>Split sieve: 3/8"</div> <div>Moist</div> <div>Dry</div> <div>Total sample wt. (g): 1596.53 1400.45</div> <div>+3/8" Coarse fraction (g): 540.34 500.74</div> <div>-3/8" Split fraction (g): 303.87 258.85</div> <div>Split fraction: 0.642</div>				<div>Water content data C.F.(+3/8") S.F.(-3/8")</div> <div>Moist soil + tare (g): 661.64 444.20</div> <div>Dry soil + tare (g): 622.05 399.18</div> <div>Tare (g): 121.42 140.33</div> <div>Water content (%): 7.9 17.4</div>		
Sieve	Accum. Wt. Ret. (g)	Grain Size (mm)	Percent Finer	←Split		
8"	-	200	-			
6"	-	150	-			
4"	-	100	-			
3"	-	75	100.0			
1.5"	123.57	37.5	91.2			
3/4"	301.05	19	78.5			
3/8"	500.74	9.5	64.2			
No.4	33.10	4.75	56.0			
No.10	78.20	2	44.8			
No.20	124.34	0.85	33.4			
No.40	161.92	0.425	24.1			
No.60	188.37	0.25	17.5			
No.100	207.55	0.15	12.7			
No.140	218.38	0.106	10.0			
No.200	227.30	0.075	7.8			

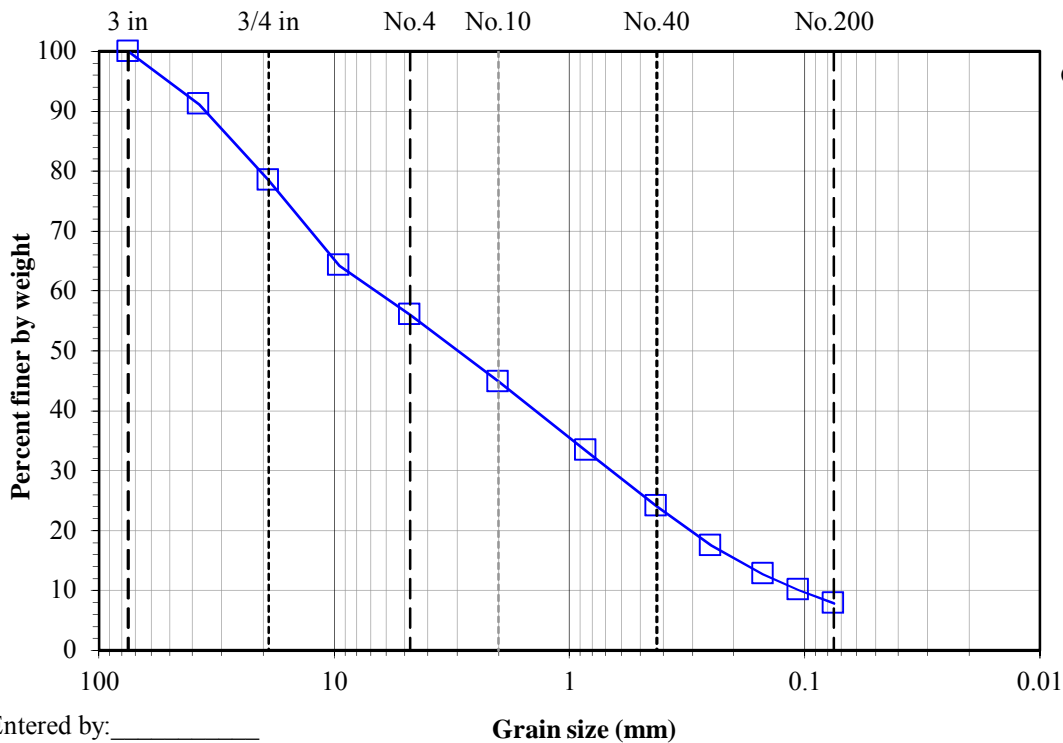

**Gravel (%):** 44.0  
**Sand (%):** 48.2  
**Fines (%):** 7.8

Entered by: \_\_\_\_\_

Reviewed: \_\_\_\_\_

**Amount of Material in Soil Finer than the No. 200 (75µm) Sieve**

(ASTM D1140)

**Project: National Ability Center****No: 02763-001****Location: Park City, Utah****Date: 3/19/2018****By: JWB**

Sample Info.	Boring No.	TP-2						
	Sample							
	Depth	8.0'						
	Split	Yes						
	Split Sieve*	3/8"						
	Method	B						
Specimen soak time (min)		230						
Moist total sample wt. (g)		1027.12						
Moist coarse fraction (g)		49.14						
Moist split fraction + tare (g)		311.26						
Split fraction tare (g)		123.04						
Dry split fraction (g)		152.49						
Dry retained No. 200 + tare (g)		181.91						
Wash tare (g)		123.04						
No. 200 Dry wt. retained (g)		58.87						
Split sieve* Dry wt. retained (g)		46.16						
Dry total sample wt. (g)		838.49						
Coarse Fraction	Moist soil + tare (g)	175.99						
	Dry soil + tare (g)	173.01						
	Tare (g)	126.85						
	Water content (%)	6.46						
Split Fraction	Moist soil + tare (g)	311.26						
	Dry soil + tare (g)	275.53						
	Tare (g)	123.04						
	Water content (%)	23.43						
Percent passing split sieve* (%)		94.5						
Percent passing No. 200 sieve (%)		58.0						

Entered by: \_\_\_\_\_

Reviewed: \_\_\_\_\_

# Collapse/Swell Potential of Soils

(ASTM D4546 Method B)

Project: **National Ability Center**

No: **02763-001**

Location: **Park City, Utah**

Date: **3/21/2018**

By: **JDF**

Boring No.: **TP-2**

Sample:

Depth: **2.0'**

Sample Description: **Brown clay**

Engineering Classification: **Not requested**


Sample type: **Laboratory compacted**

Compaction specifications: **Provided by client**

Consolidometer No.: **2**  
Specific gravity,  $G_s$ : **2.70** **Assumed**  
Swell (%): **26.3**  
Swell stress (psf): **100**  
Water type used for inundation **Tap**

Dry unit weight		107	pcf	
at		17.8	(%) w	
Stress (psf)	Dial (in.)	1-D $\epsilon_v$ (%)	H <sub>c</sub> (in.)	e
Seating	0.2534	0.00	0.7880	0.471
20	0.2534	0.00	0.7880	0.471
100	0.2535	0.01	0.7879	0.471
100	0.0461	-26.31	0.9953	0.858

	Initial (o)	Final (f)
Sample height, H (in.)	0.788	0.9953
Sample diameter, D (in.)	2.344	2.344
Mass rings + wet soil (g)	151.62	181.19
Mass rings/tare (g)	41.78	41.78
Moist unit wt., $\gamma_m$ (pcf)	123.06	123.65
Wet soil + tare (g)	151.62	261.91
Dry soil + tare (g)	144.05	225.93
Tare (g)	41.78	126.85
Water content, w (%)	7.4	36.3
Dry unit wt., $\gamma_d$ (pcf)	114.57	90.71
Saturation	42.42	100.00

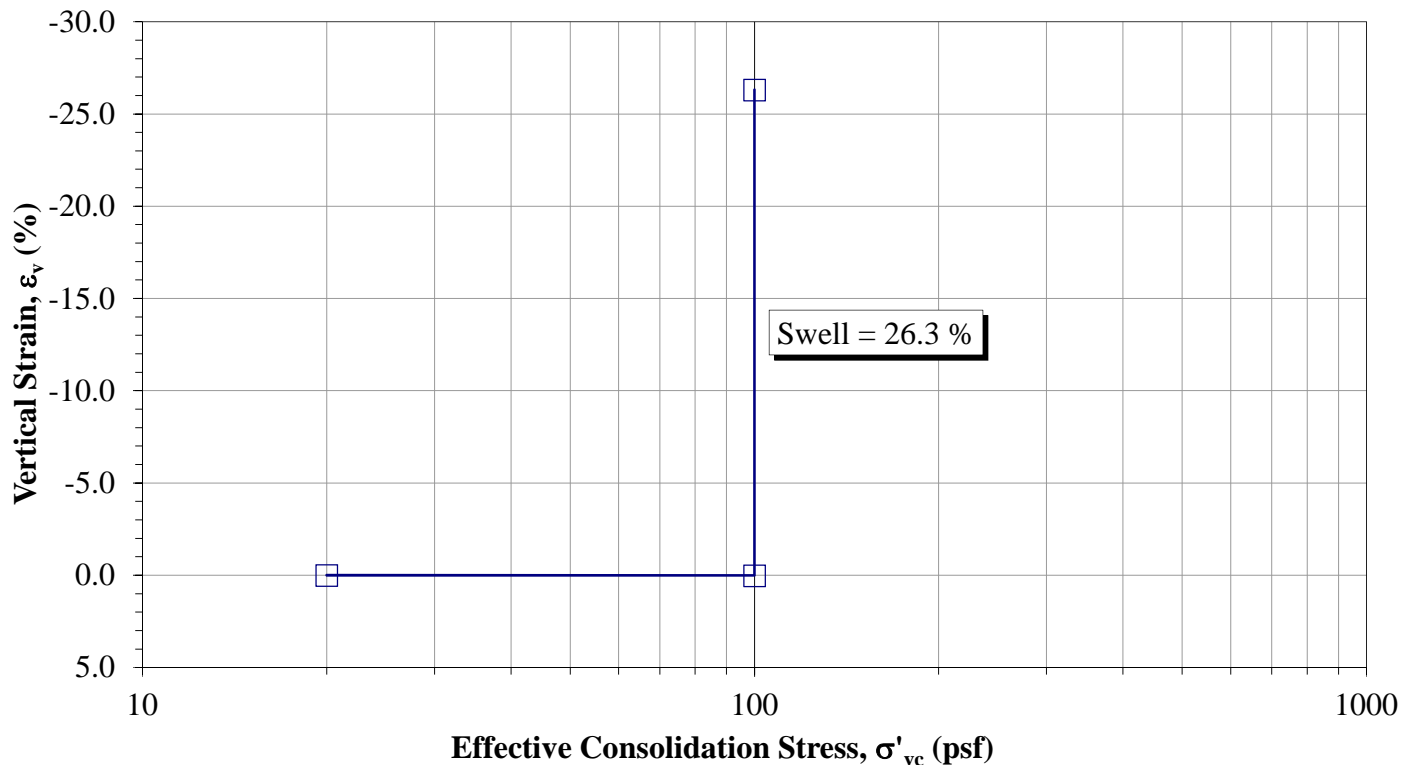

Comments: **Test specimen was compacted to a dry unit weight of 107.0 pcf (110% of TP-3 @2.0') at 17.8% water content and allowed to air dry before testing.**

Entered: \_\_\_\_\_

Reviewed: \_\_\_\_\_

**Collapse/Swell Potential of Soils**

(ASTM D4546 Method B)

Project: **National Ability Center**No: **02763-001**Location: **Park City, Utah**Date: **3/16/2018**By: **JDF**Boring No.: **TP-3**


Sample:

Depth: **2.0'**Sample Description: **Brown clay**Engineering Classification: **Not requested**Sample type: **Undisturbed-trimmed from thin-wall**

Consolidometer No.: **7**  
 Specific gravity,  $G_s$  **2.70** *Assumed*  
 Swell (%) **0.6**  
 Swell stress (psf) **800**  
 Water type used for inundation **Tap**

	Initial (o)	Final (f)
Sample height, H (in.)	<b>0.793</b>	0.7844
Sample diameter, D (in.)	<b>2.418</b>	2.418
Mass rings + wet soil (g)	<b>158.03</b>	<b>161.10</b>
Mass rings/tare (g)	<b>41.17</b>	41.17
Moist unit wt., $\gamma_m$ (pcf)	122.25	126.84
Wet soil + tare (g)	<b>457.39</b>	<b>243.28</b>
Dry soil + tare (g)	<b>398.26</b>	<b>219.77</b>
Tare (g)	<b>122.30</b>	<b>124.28</b>
Water content, w (%)	21.4	24.6
Dry unit wt., $\gamma_d$ (pcf)	100.68	101.78
Saturation	85.82	100.00

Stress (psf)	Dial (in.)	1-D $\epsilon_v$ (%)	$H_c$ (in.)	e
<b>Seating</b>	<b>0.2590</b>	0.00	0.7930	0.674
<b>20</b>	<b>0.2590</b>	0.00	0.7930	0.674
<b>100</b>	<b>0.2593</b>	0.04	0.7927	0.673
<b>200</b>	<b>0.2618</b>	0.35	0.7902	0.668
<b>400</b>	<b>0.2668</b>	0.98	0.7852	0.658
<b>800</b>	<b>0.2721</b>	1.65	0.7799	0.646
<b>800</b>	<b>0.2676</b>	1.08	0.7844	0.656

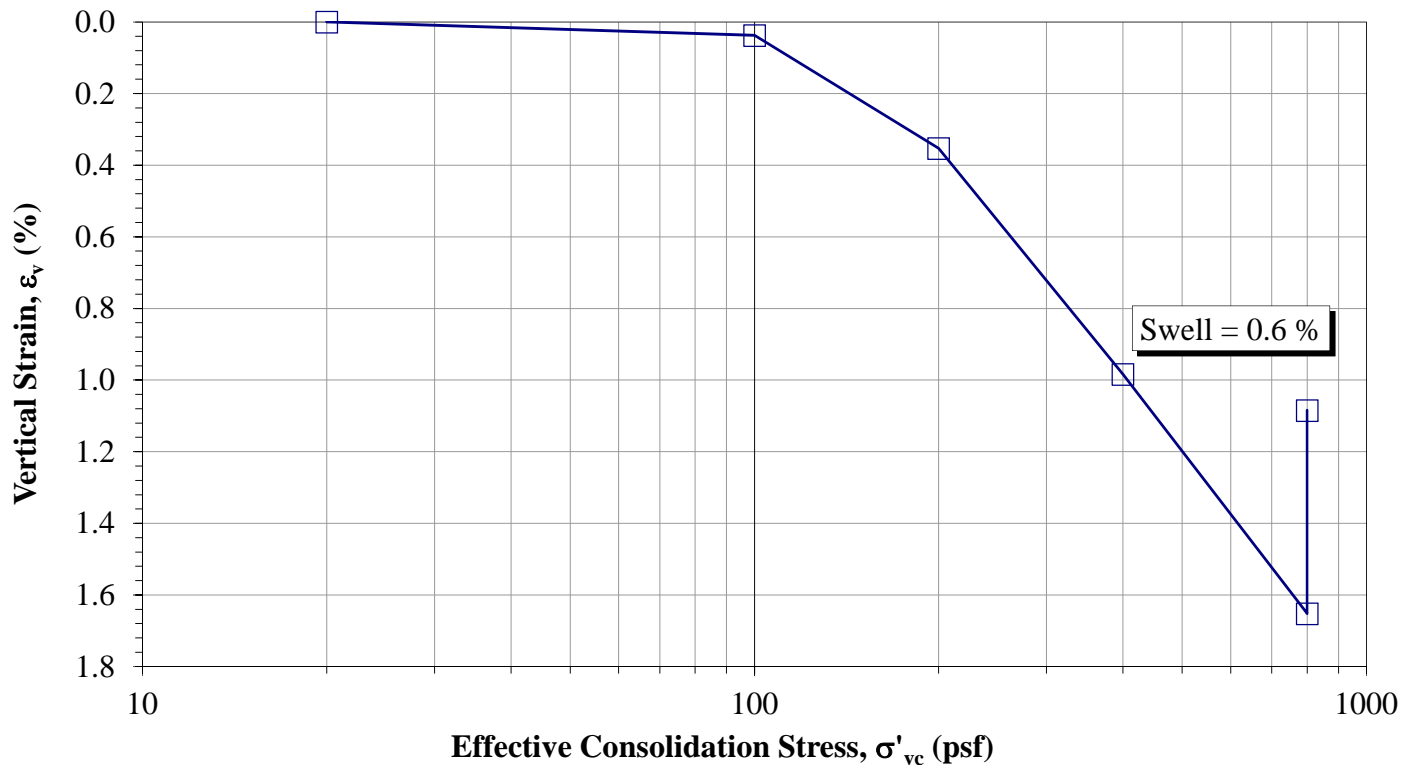

Entered: \_\_\_\_\_

Reviewed: \_\_\_\_\_

# Unconsolidated-Undrained Triaxial Compression Test on Cohesive Soils

(ASTM D2850)



© IGES 2005, 2018

Project: **National Ability Center**

No: **02763-001**

Location: **Park City, Utah**

Date: **3/19/2018**

By: **EH**

Boring No.: **TP-1**

Sample:

Depth: **4.0'**

Sample Description: **Brown sandy clay**


Sample type: **Undisturbed**

Specific gravity,  $G_s$  2.70 Assumed  
 Sample height,  $H$  (in.) 5.275  
 Sample diameter,  $D$  (in.) 2.407  
 Sample volume,  $V$  (ft<sup>3</sup>) 0.0139  
 Wt. rings + wet soil (g) 776.73  
 Wt. rings/tare (g) 0.00  
 Moist soil,  $W_s$  (g) 776.73  
 Moist unit wt.,  $\gamma_m$  (pcf) 123.3  
 Dry unit wt.,  $\gamma_d$  (pcf) 103.7  
 Saturation (%) 81.2  
 Void ratio,  $e$  0.63



Wet soil + tare (g) 794.64  
 Dry soil + tare (g) 688.77  
 Tare (g) 128.52  
 Water content,  $w$  (%) 18.9  
 Confining stress,  $\sigma_3$  (psf) 200  
 Shear rate (in/min) 0.0158  
 Strain at failure,  $\epsilon_f$  (%) 5.45  
 Deviator stress at failure,  $(\sigma_1 - \sigma_3)_f$  (psf) 2715  
 Shear stress at failure,  $q_f = (\sigma_1 - \sigma_3)_f / 2$  (psf) 1358

Axial Strain (%)	$\sigma_d$ $\sigma_1 - \sigma_3$ (psf)	$Q$ $1/2 \sigma_d$ (psf)
0.00	0.0	0.0
0.05	149.0	74.5
0.10	239.9	119.9
0.15	372.1	186.0
0.20	458.6	229.3
0.25	557.5	278.7
0.30	627.3	313.7
0.35	701.3	350.6
0.40	775.1	387.5
0.45	828.2	414.1
0.70	1109.6	554.8
0.95	1356.6	678.3
1.20	1590.1	795.0
1.45	1777.5	888.7
1.70	1906.9	953.4
1.95	2043.7	1021.8
2.20	2155.5	1077.7
2.45	2254.5	1127.2
2.71	2328.7	1164.3
2.95	2402.7	1201.3
3.20	2460.2	1230.1
3.45	2501.3	1250.6
3.70	2558.1	1279.0
3.95	2598.7	1299.3
4.20	2623.1	1311.5
4.45	2635.5	1317.7
4.70	2663.6	1331.8
4.95	2683.7	1341.8
5.45	2715.4	1357.7
5.95	2692.2	1346.1
6.45	2661.2	1330.6
6.95	2634.3	1317.1
7.45	2611.3	1305.6
7.95	2622.8	1311.4
8.45	2622.6	1311.3
8.95	2629.7	1314.8
9.45	2636.6	1318.3
9.95	2635.8	1317.9
10.45	2638.6	1319.3
10.95	2622.6	1311.3
11.45	2617.8	1308.9
11.95	2605.5	1302.7
12.45	2600.3	1300.1
12.95	2598.7	1299.3
13.45	2607.7	1303.8
13.95	2609.2	1304.6
14.45	2592.8	1296.4
14.95	2597.6	1298.8
15.45	2598.5	1299.2
15.95	2592.4	1296.2
16.45	2586.1	1293.0
16.95	2596.9	1298.4
17.45	2610.8	1305.4
17.95	2597.1	1298.5
18.45	2586.8	1293.4
18.95	2576.3	1288.1
19.45	2562.5	1281.2
19.89	2563.9	1281.9

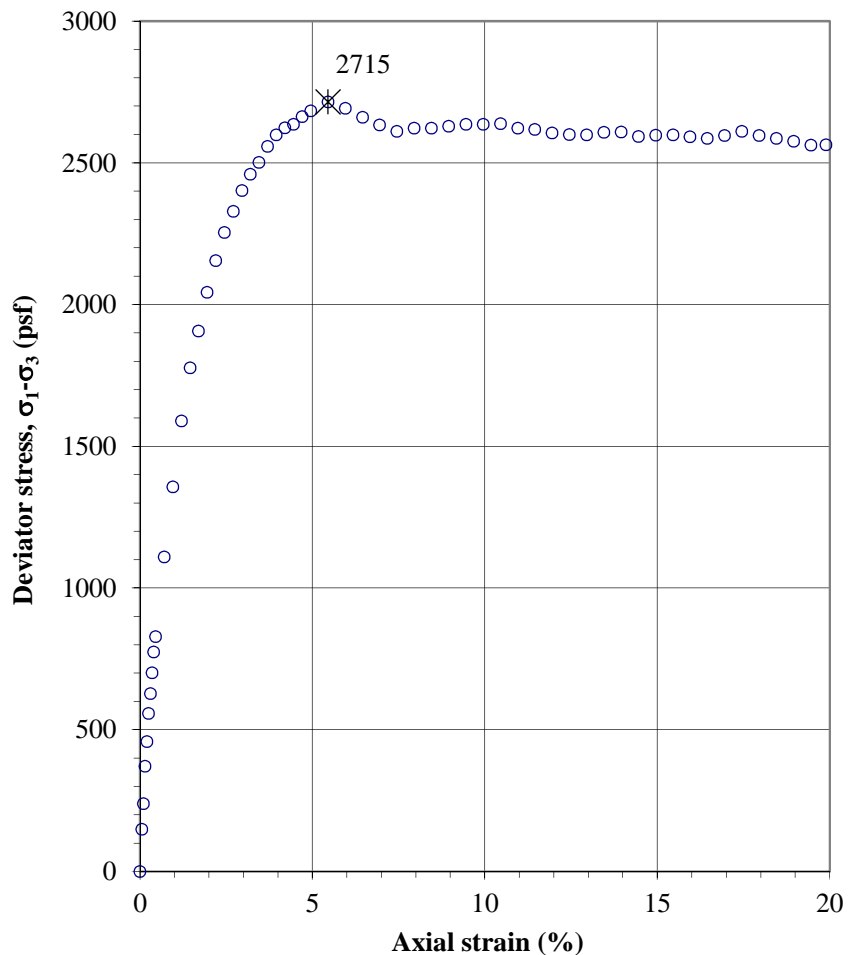

Entered by: \_\_\_\_\_

Reviewed: \_\_\_\_\_

# **APPENDIX D**

# **Design Maps Summary Report**

## User-Specified Input


**Report Title** National Ability Center  
Tue March 13, 2018 22:13:50 UTC

**Building Code Reference Document** 2012/2015 International Building Code  
(which utilizes USGS hazard data available in 2008)

**Site Coordinates** 40.6816°N, 111.4747°W

**Site Soil Classification** Site Class D – “Stiff Soil”


**Risk Category** I/II/III

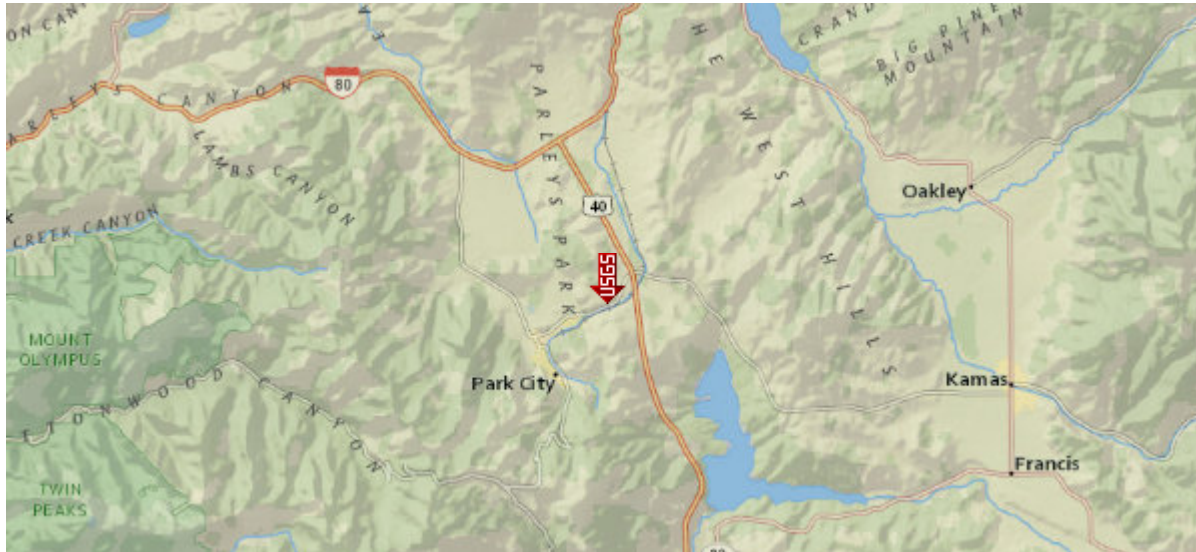

## USGS-Provided Output

$S_s = 0.624 \text{ g}$	$S_{MS} = 0.812 \text{ g}$	$S_{DS} = 0.541 \text{ g}$
$S_1 = 0.209 \text{ g}$	$S_{M1} = 0.414 \text{ g}$	$S_{D1} = 0.276 \text{ g}$

For information on how the  $S_s$  and  $S_1$  values above have been calculated from probabilistic (risk-targeted) and deterministic ground motions in the direction of maximum horizontal response, please return to the application and select the “2009 NEHRP” building code reference document.

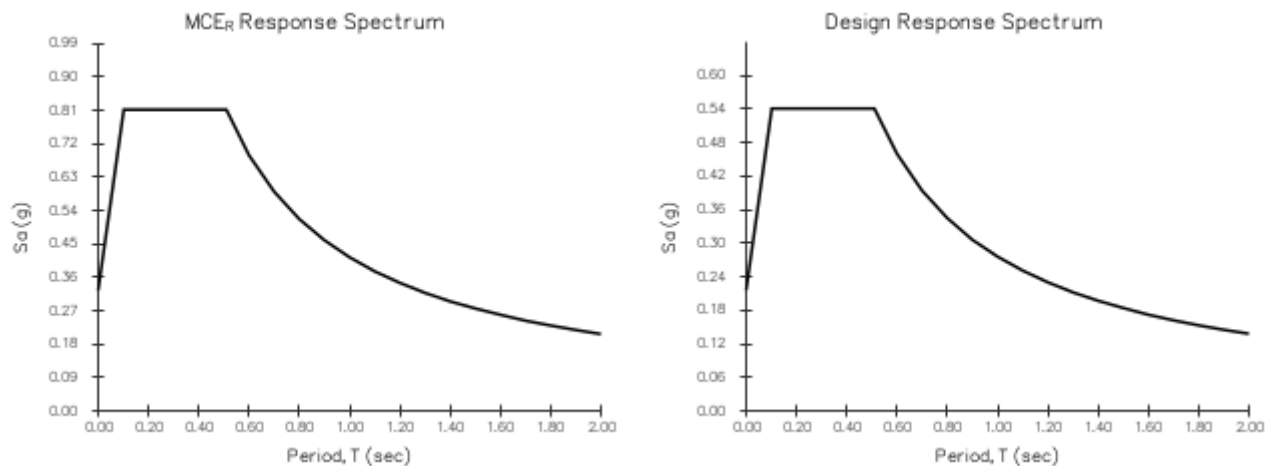

Although this information is a product of the U.S. Geological Survey, we provide no warranty, expressed or implied, as to the accuracy of the data contained therein. This tool is not a substitute for technical subject-matter knowledge.



# Design Maps Detailed Report

2012/2015 International Building Code (40.6816°N, 111.4747°W)

Site Class D – “Stiff Soil”, Risk Category I/II/III

## Section 1613.3.1 — Mapped acceleration parameters

Note: Ground motion values provided below are for the direction of maximum horizontal spectral response acceleration. They have been converted from corresponding geometric mean ground motions computed by the USGS by applying factors of 1.1 (to obtain  $S_s$ ) and 1.3 (to obtain  $S_1$ ). Maps in the 2012/2015 International Building Code are provided for Site Class B. Adjustments for other Site Classes are made, as needed, in Section 1613.3.3.

From [Figure 1613.3.1\(1\)](#) <sup>[1]</sup>

$$S_s = 0.624 \text{ g}$$

From [Figure 1613.3.1\(2\)](#) <sup>[2]</sup>

$$S_1 = 0.209 \text{ g}$$

## Section 1613.3.2 — Site class definitions

The authority having jurisdiction (not the USGS), site-specific geotechnical data, and/or the default has classified the site as Site Class D, based on the site soil properties in accordance with Section 1613.

2010 ASCE-7 Standard – Table 20.3-1  
SITE CLASS DEFINITIONS

Site Class	$\bar{v}_s$	$\bar{N}$ or $\bar{N}_{ch}$	$\bar{s}_u$
A. Hard Rock	>5,000 ft/s	N/A	N/A
B. Rock	2,500 to 5,000 ft/s	N/A	N/A
C. Very dense soil and soft rock	1,200 to 2,500 ft/s	>50	>2,000 psf
D. Stiff Soil	600 to 1,200 ft/s	15 to 50	1,000 to 2,000 psf
E. Soft clay soil	<600 ft/s	<15	<1,000 psf
Any profile with more than 10 ft of soil having the characteristics:			
<ul style="list-style-type: none"> <li>• Plasticity index <math>PI &gt; 20</math>,</li> <li>• Moisture content <math>w \geq 40\%</math>, and</li> <li>• Undrained shear strength <math>\bar{s}_u &lt; 500</math> psf</li> </ul>			
F. Soils requiring site response analysis in accordance with Section 21.1	See Section 20.3.1		

For SI: 1ft/s = 0.3048 m/s 1lb/ft<sup>2</sup> = 0.0479 kN/m<sup>2</sup>

### Section 1613.3.3 — Site coefficients and adjusted maximum considered earthquake spectral response acceleration parameters

TABLE 1613.3.3(1)  
VALUES OF SITE COEFFICIENT  $F_a$

Site Class	Mapped Spectral Response Acceleration at Short Period				
	$S_s \leq 0.25$	$S_s = 0.50$	$S_s = 0.75$	$S_s = 1.00$	$S_s \geq 1.25$
A	0.8	0.8	0.8	0.8	0.8
B	1.0	1.0	1.0	1.0	1.0
C	1.2	1.2	1.1	1.0	1.0
D	1.6	1.4	1.2	1.1	1.0
E	2.5	1.7	1.2	0.9	0.9
F	See Section 11.4.7 of ASCE 7				

Note: Use straight-line interpolation for intermediate values of  $S_s$

**For Site Class = D and  $S_s = 0.624$  g,  $F_a = 1.301$**

TABLE 1613.3.3(2)  
VALUES OF SITE COEFFICIENT  $F_v$

Site Class	Mapped Spectral Response Acceleration at 1-s Period				
	$S_1 \leq 0.10$	$S_1 = 0.20$	$S_1 = 0.30$	$S_1 = 0.40$	$S_1 \geq 0.50$
A	0.8	0.8	0.8	0.8	0.8
B	1.0	1.0	1.0	1.0	1.0
C	1.7	1.6	1.5	1.4	1.3
D	2.4	2.0	1.8	1.6	1.5
E	3.5	3.2	2.8	2.4	2.4
F	See Section 11.4.7 of ASCE 7				

Note: Use straight-line interpolation for intermediate values of  $S_1$

**For Site Class = D and  $S_1 = 0.209$  g,  $F_v = 1.983$**

**Equation (16-37):**

$$S_{MS} = F_a S_S = 1.301 \times 0.624 = 0.812 \text{ g}$$

---

**Equation (16-38):**

$$S_{M1} = F_v S_1 = 1.983 \times 0.209 = 0.414 \text{ g}$$

---

#### Section 1613.3.4 — Design spectral response acceleration parameters

**Equation (16-39):**

$$S_{DS} = \frac{2}{3} S_{MS} = \frac{2}{3} \times 0.812 = 0.541 \text{ g}$$

---

**Equation (16-40):**

$$S_{D1} = \frac{2}{3} S_{M1} = \frac{2}{3} \times 0.414 = 0.276 \text{ g}$$

---

## Section 1613.3.5 — Determination of seismic design category

TABLE 1613.3.5(1)

SEISMIC DESIGN CATEGORY BASED ON SHORT-PERIOD (0.2 second) RESPONSE ACCELERATION

VALUE OF $S_{DS}$	RISK CATEGORY		
	I or II	III	IV
$S_{DS} < 0.167g$	A	A	A
$0.167g \leq S_{DS} < 0.33g$	B	B	C
$0.33g \leq S_{DS} < 0.50g$	C	C	D
$0.50g \leq S_{DS}$	D	D	D

For Risk Category = I and  $S_{DS} = 0.541 g$ , Seismic Design Category = D

TABLE 1613.3.5(2)

SEISMIC DESIGN CATEGORY BASED ON 1-SECOND PERIOD RESPONSE ACCELERATION

VALUE OF $S_{D1}$	RISK CATEGORY		
	I or II	III	IV
$S_{D1} < 0.067g$	A	A	A
$0.067g \leq S_{D1} < 0.133g$	B	B	C
$0.133g \leq S_{D1} < 0.20g$	C	C	D
$0.20g \leq S_{D1}$	D	D	D

For Risk Category = I and  $S_{D1} = 0.276 g$ , Seismic Design Category = D

Note: When  $S_1$  is greater than or equal to  $0.75g$ , the Seismic Design Category is **E** for buildings in Risk Categories I, II, and III, and **F** for those in Risk Category IV, irrespective of the above.

Seismic Design Category  $\equiv$  "the more severe design category in accordance with Table 1613.3.5(1) or 1613.3.5(2)" = D

Note: See Section 1613.3.5.1 for alternative approaches to calculating Seismic Design Category.

## References

1. Figure 1613.3.1(1): [https://earthquake.usgs.gov/hazards/designmaps/downloads/pdfs/IBC-2012-Fig1613p3p1\(1\).pdf](https://earthquake.usgs.gov/hazards/designmaps/downloads/pdfs/IBC-2012-Fig1613p3p1(1).pdf)
2. Figure 1613.3.1(2): [https://earthquake.usgs.gov/hazards/designmaps/downloads/pdfs/IBC-2012-Fig1613p3p1\(2\).pdf](https://earthquake.usgs.gov/hazards/designmaps/downloads/pdfs/IBC-2012-Fig1613p3p1(2).pdf)