

CONSTRUCTION NOTES:

- LUMINAIRE SWITCHING SHALL COMPLY WITH 2016 N.E.C.
- ALL NORMAL LIGHTING CIRCUITS SHALL BE ROUTED VIA RELAY/CONTACTORS IN LIGHTING CONTROL PANEL. VERIFY ALL FINAL LOCATIONS AND REQUIREMENTS IN FIELD PRIOR TO INSTALLATION.
- EMERGENCY FIXTURES WITH BATTERY BACKUP.
- UNLESS SHOWN ON PLAN OR NOTED OTHERWISE, ALL ELECTRICAL WORK IS NEW.
- ALL OCCUPANCY SENSORS (CEILING AND/OR WALL) SHALL BE SUITABLE FOR CONTROL OF THE LOAD TYPE (FLUORESCENT), LOAD CAPACITY, AND BRANCH CIRCUIT VOLTAGE OF THE LIGHTING FIXTURES CONTROLLED. DUAL TECHNOLOGY TYPE, WITH USER ADJUSTABLE TIME DELAY AND SENSITIVITY SETTINGS. PROVIDE DUAL LEVEL SWITCHING FOR ALL OCCUPANCY SENSORS, MANUFACTURER: LEVITON CAT. # OSCIO-MOM OR EQUAL. COORDINATE WITH SENSOR'S MANUFACTURER FOR EXACT NUMBER OF SENSORS.
- EXIT SIGN. SEE ARCH. DRAWINGS FOR EXACT NO. OF SIGNS. COORDINATE FACE, COLOR, DIRECTIONAL ARROWS AND ORIENTATION WITH ARCH. AND FIRE MARSHAL (TYP. ALL LOCATIONS). CONNECT TO NEAREST RECEPTACLE.
- EXHAUST FANS INTERLOCKED WITH ROOM LIGHTS.

GENERAL NOTES:

- COORDINATE LOCATIONS OF ALL LIGHTING FIXTURES AND CEILING MOUNTED DEVICES WITH THE ARCHITECTURAL REFLECTED CEILING PLANS.

ELEC. NOTES:

- ALL NEWLY INSTALLED OR RELOCATED SWITCHES THAT ARE INTENDED TO BE USED BY THE OCCUPANT OF THE ROOM OR AREA WITH REGARD TO CONTROLLING LIGHTING AND RECEPTACLE OUTLETS/APPLIANCES, OR COOLING, HEATING AND VENTILATION EQUIPMENT SHALL BE NO GREATER THAN 48" ABOVE THE FLOOR OR WORKING PLATFORM TO TOP OF ELECTRICAL BOX, OR NO LESS THAN 15" ABOVE THE FLOOR OR WORKING PLATFORM TO THE BOTTOM OF THE ELECTRICAL BOX.

- ALL SWITCH AND OUTLET COVERS TO BE WHITE.

LIGHTING FIXTURE SCHEDULE						
TYPE	DESCRIPTION	SYMBOL	LAMP		TOTAL WATTS	REMARKS
			TYPE	WATTS		
L1 1	RECESSED 2X4 HIGH LUMEN LED, 1200 LUMENS 120V W/ CURVED LINEAR PRISMATIC DIFFUSER	L1	LED	34	34	LITHONIA 2BLT 2BLT-2X4BLT, 12L, 1200 LUMENS
L2 1	RECESSED 2X4 LOW LUMEN LED, 4000 LUMENS 120V W/ CURVED LINEAR PRISMATIC DIFFUSER	L2	LED	34	34	LITHONIA 2BLT 2BLT-2X4BLT, 40L, 4000 LUMENS
L3 1	RECESSED CAN LIGHT LED 6" NLCBC-65, COLOR TEMP 3500 K, WW-WHITE		LED	16.6	16.6	NLCBC-65 COBALT NL CBC GG REFLECTOR
L4 1	PENDENT LIGHTING SORRA SOLITUDE PENDENT		LED	8	8	8 WATT , 300 LUMENS 3000 LED MODULE
L5 1	LARGE PENDENT LIGHTING WESTPORT LIGHTING 5408		LED	25	25	25 WATT, 2150 LUMEN 3000K LED MODULE 0-10V DIMMING
L6 1	WALL SCONCE REGALDIMMABLE SATIN NICKLE EDGE LIGHTING 24" HIGH, 120V/40W, LAMP 1-24 W LED		LED	31	31	
EEM 1	EXIT + EMERGENCY LIGHT, ELX-TEU LED EDGE-LIT" RED LETTERS" 90 MINUTES BATTERY					
EEMI 1	EXIT + EMERGENCY LIGHT, SIMPLICITY ECONOMIZER DIRECTIONAL - CEILING MOUNTED 90 MINUTES BATTERY					
EM 1						

LIGHTING VENDOR: WIDENBACH-BROWN



LIGHTING PLAN

1/4"=1'-0"

ELEC. SWITCH NOTE:

- S_M MULTI-LEVEL OCCUPANCY SENSOR SWITCHES TO SENTRY TYPE WALL SWITCHES
- SWITCHED: OCCUPANCY SENSOR
 - SWITCHED: TIME CLOCK

S_{MD} DIMMER SWITCH AT ALL WAX ROOMS SHALL BE:
DIMMING OCCUPANCY WALL SWITCH
ACUITY CONTROLS MODEL # WEX-D
SWITCH VENDOR:
WIDENBACH-BROWN

- S_D DIMMER SWITCH AT HALLWAY SWITCHES TO SENTRY TYPE WALL SWITCHES
- SWITCHED: OCCUPANCY SENSOR
 - SWITCHED: TIME CLOCK

EXTERIOR SIGNS:

- INTERNALLY ILLUMINATED SIGNS MAY HAVE 12W/S.F. (ONLY ONE SIDE OF 2 SIDES SIGN)
- SIGN UNDER SEPARATE PERMIT

SPEAKER NOTE:

- ALL SPEAKERS AT ALTAS ROUND SPEAKERS
- PAINT SPEAKERS TO MATCH CEILING COLOR.
- ALL WAX ROOMS SHALL HAVE SPEAKERS

PRIOR TO FINAL INSPECTION:

ILLUMINATION LEVEL PER 1006.2 PERFORMANCE PER 1006.4 &
EMERGENCY POWER PER 1006.3

JOINT VENTURE PROJECT



3578 30th Street
San Diego, CA 92104
V. 619.236.0595
F. 619.236.0557
www.mpa-architects.com
MEMBER
AMERICAN INSTITUTE OF ARCHITECTS




THOMAS
BOUFFARD
ARCHITECTS, INC
1822 MAIN STREET
HUNTINGTON BEACH, CA
92648
(707) 372-8156
tom.tbarchitects@gmail.com

PROJECT TITLE:

EUROPEAN WAX
CENTER
1440 S FOOTHILL DR
SUITE 140
SALT LAKE CITY, UT
84108

SHEET DESCRIPTION

LIGHTING
PLAN

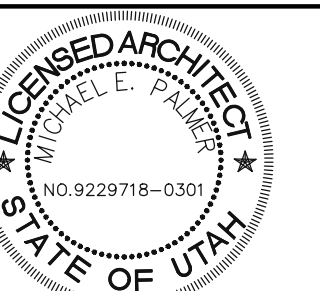

REVISIONS:
OWNER REVIEW
08-30-2019- Plan Check Corrections

DWN TB
DATE 8-22-2019
CHK TB
SCALE AS NOTED
PROJ. 2019-50

SHEET

E2.0